


0 50m 100m 150m 200m

**LEGEND**

- Road
- Land Parcel
- Building
- Stream / River
- Townland Boundary
- Existing Electricity Lines
- Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)
- Guarding Location - Temporary Works
- Proposed 400 kV Angle Tower Location
- Proposed 400 kV Intermediate Tower Location
- Outer Conductor
- Centreline of Proposed Line Route
- Outer Conductor
- Forestry
- Lake
- Geo - Directory Point
- Marsh

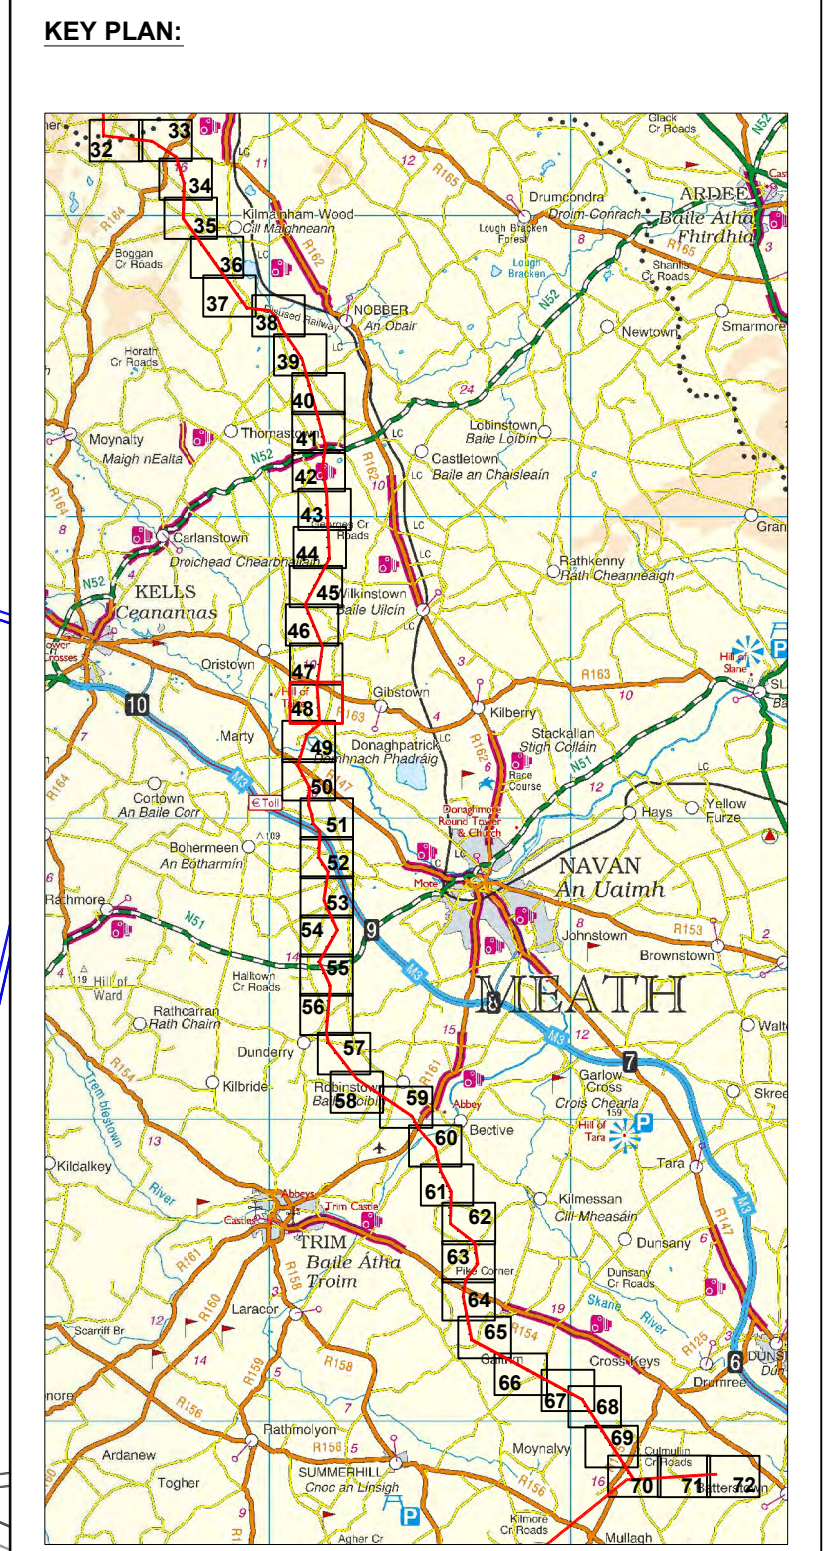

**NOTES:**

- Transmission lines and towers not to be scaled.
- For details of proposed structures see structure description schedule.
- Figured dimensions only to be taken from this drawing.
- Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2312, 2375, 2375-A

**DRAFT**

Rev	Date	Description	By	Chkd.
C	Feb. '15	UPDATE FOLLOWING DESIGN REVIEW	MN	DG
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

**NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT**

Title:

**MEATH STUDY AREA (MSA)  
1:2,500 LINE ROUTE MAP  
- Sheet 48 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: M. Nolan      Checked: D. Grehan      Date: February 2015

Project Director: D. Grehan

Planning Dwg Ref: MT-004-048

TOBIN Consulting Engineers,  
Block 10-4, Blanchardstown Corporate Park,  
Dublin 15, Ireland.  
tel: +353-(0)1-8030406  
fax: +353-(0)1-8030409  
e-mail: dublin@tobin.ie  
www.tobin.ie

Drawing No.: **6244-2027**

Revision: **C**

AILTIN (eltown)