


LEGEND	
	Road
	Land Parcel
	Building
	Stream / River
	Townland Boundary
	Existing Electricity Lines
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)
	Guarding Location - Temporary Works
	Proposed 400 kV Angle Tower Location
	Proposed 400 kV Intermediate Tower Location
	Outer Conductor
	Centreline of Proposed Line Route
	Outer Conductor
	Forestry
	Lake
	Geo - Directory Point
	Marsh

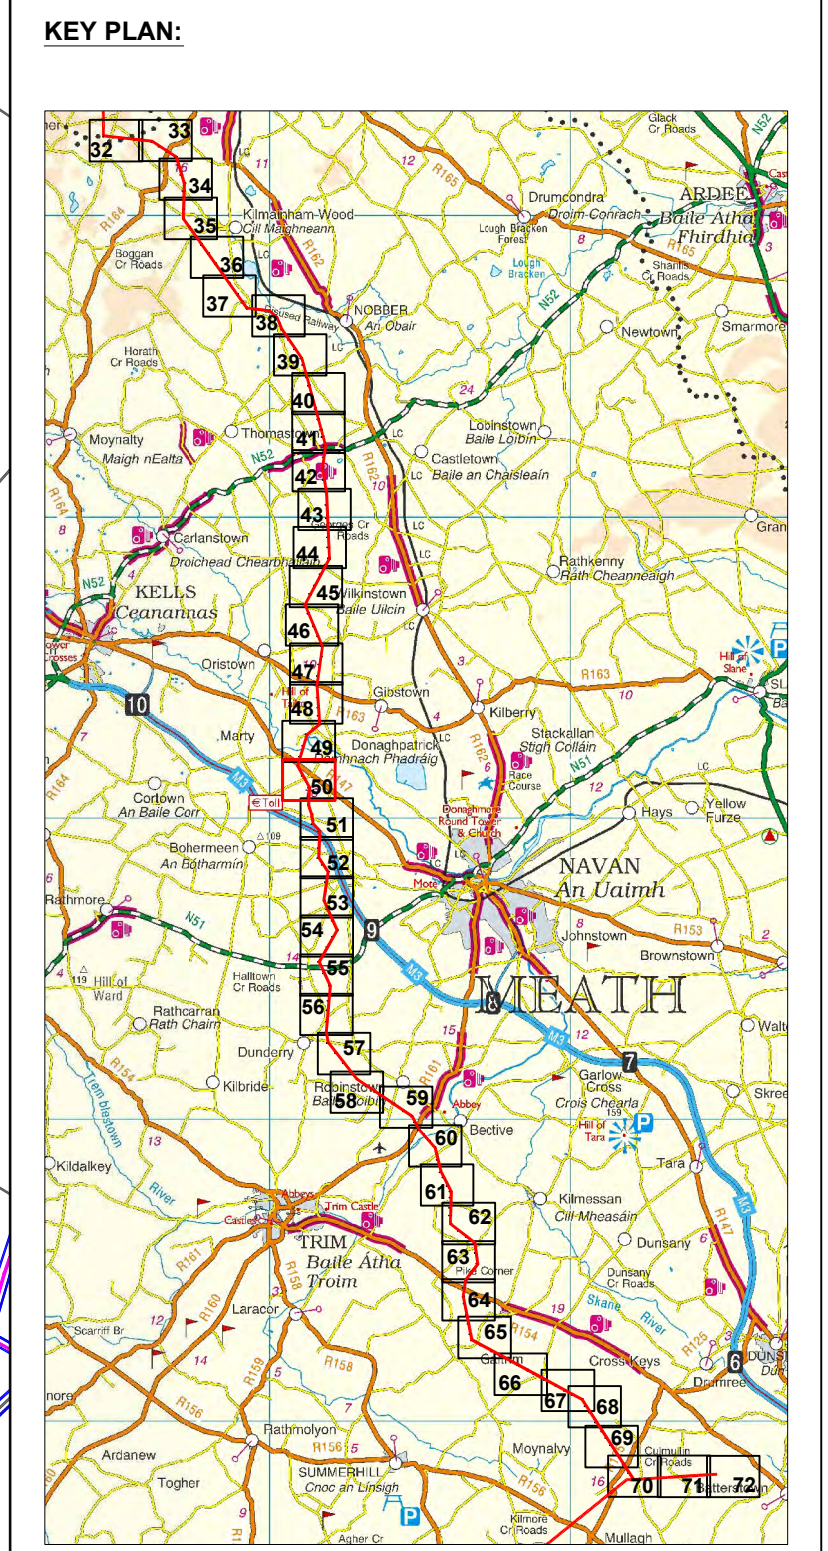

- NOTES:**
1. Transmission lines and towers not to be scaled.
  2. For details of proposed structures see structure description schedule.
  3. Figured dimensions only to be taken from this drawing.
  4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2375, 2375-C, 2437, 2437-B

**DRAFT**

Rev	Date	Description	By	Chkd.
C	Feb. '15	UPDATE FOLLOWING DESIGN REVIEW	MN	DG
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project: **NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT**

Title: **MEATH STUDY AREA (MSA) 1:2,500 LINE ROUTE MAP - Sheet 50 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: <b>M. Nolan</b>	Checked: <b>D. Grehan</b>	Date: <b>February 2015</b>
Project Director: <b>D. Grehan</b>		
Planning Dwg Ref: <b>MT-004-050</b>		

**TOBIN** Consulting Engineers,  
 Block 10-4, Blanchardstown Corporate Park,  
 Dublin 15, Ireland.  
 tel: +353-(0)1-8030406  
 fax: +353-(0)1-8030409  
 e-mail: [dublin@tobin.ie](mailto:dublin@tobin.ie)  
 www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and provided. Client's approval and liability is required in writing by TOBIN Consulting Engineers, its copyright holder, no part of this document may be reproduced or transmitted in any form and this document shall not be relied upon by any party for any purpose.

Drawing No.: **6244-2029** Revision: **C**