

Note: Number, size and depth of anchors for each site to be decided after full Site Investigation.

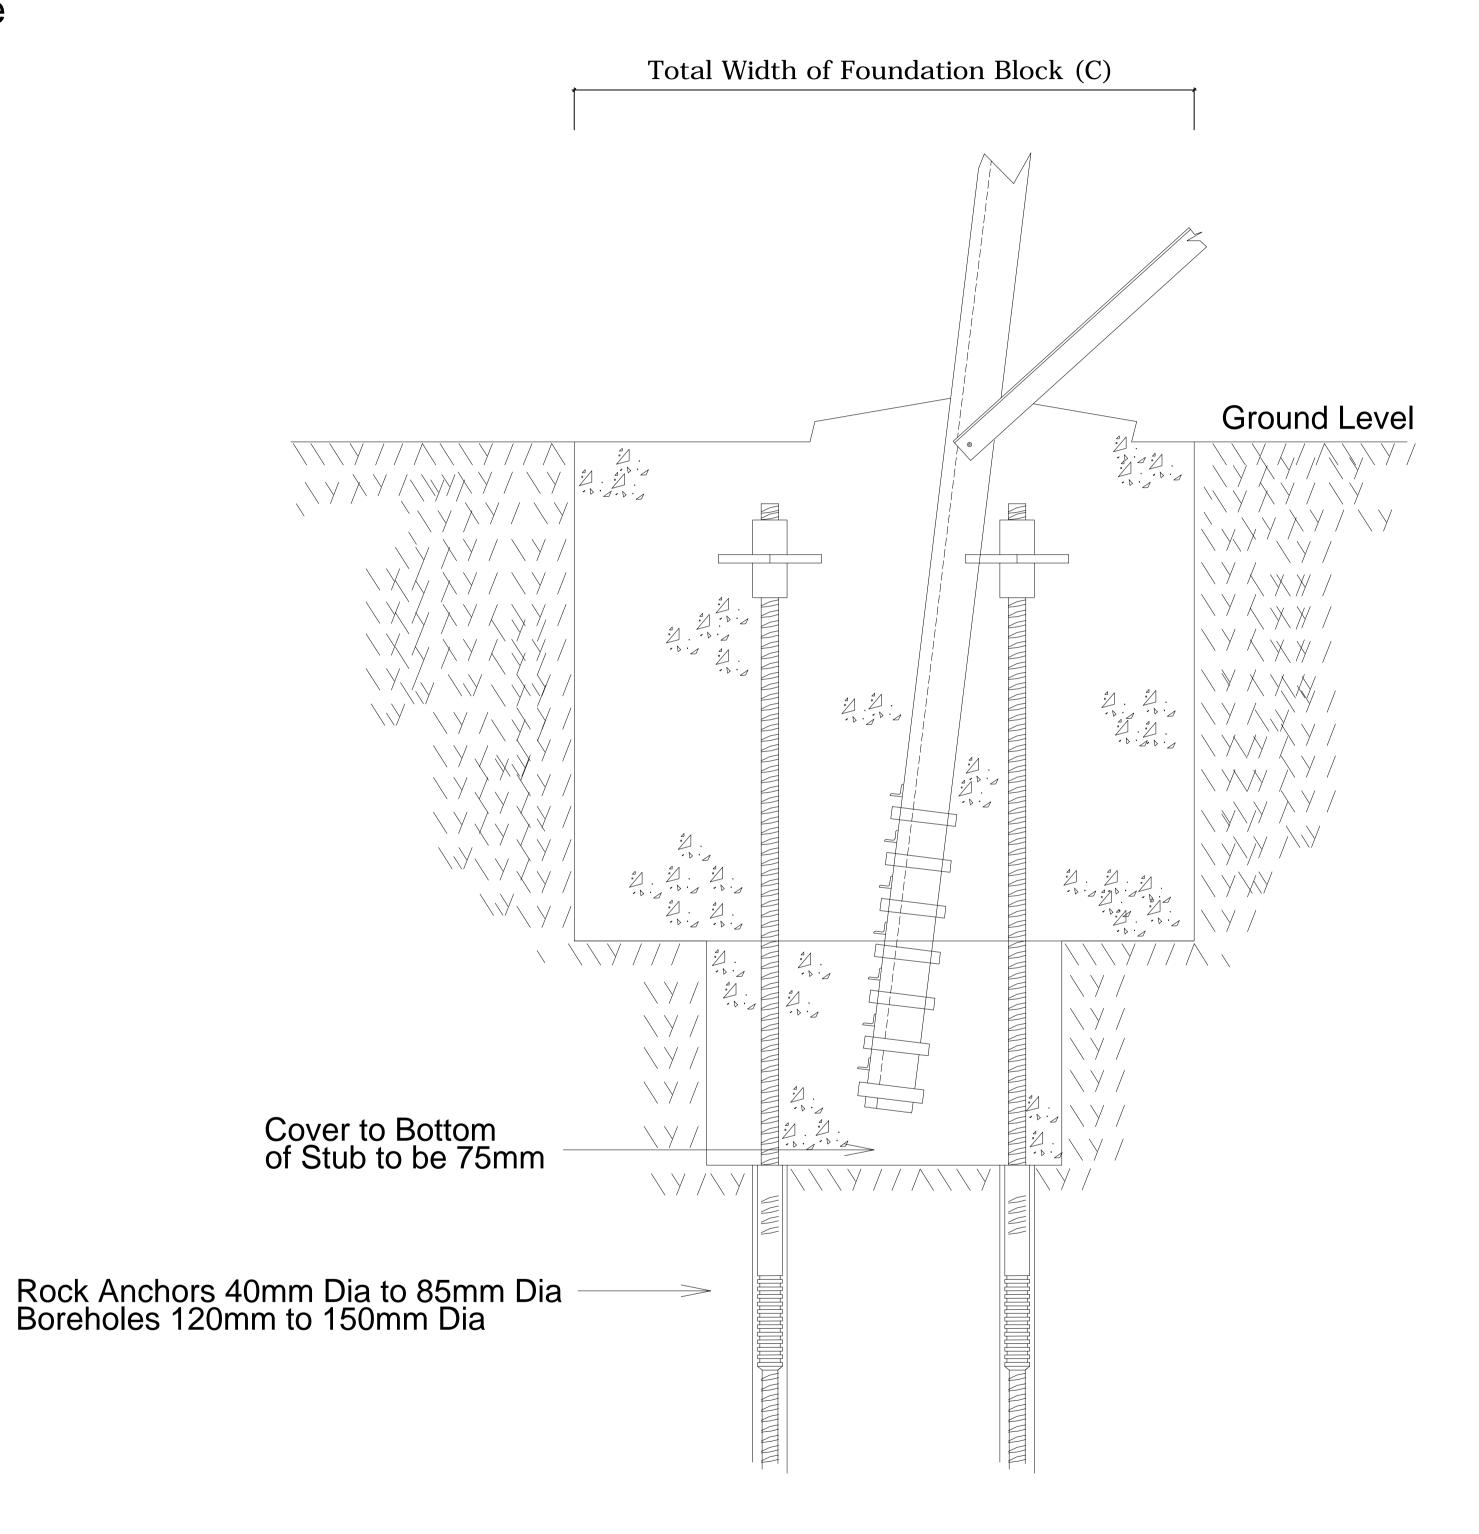

Foundation Width	C (m) Min	C (m) Max
400kV SC Int	2.2	3.7
400kV SC 30	3.8	7.3
400kV SC 60	4.9	8.1
400kV SC 90	5.1	8.8

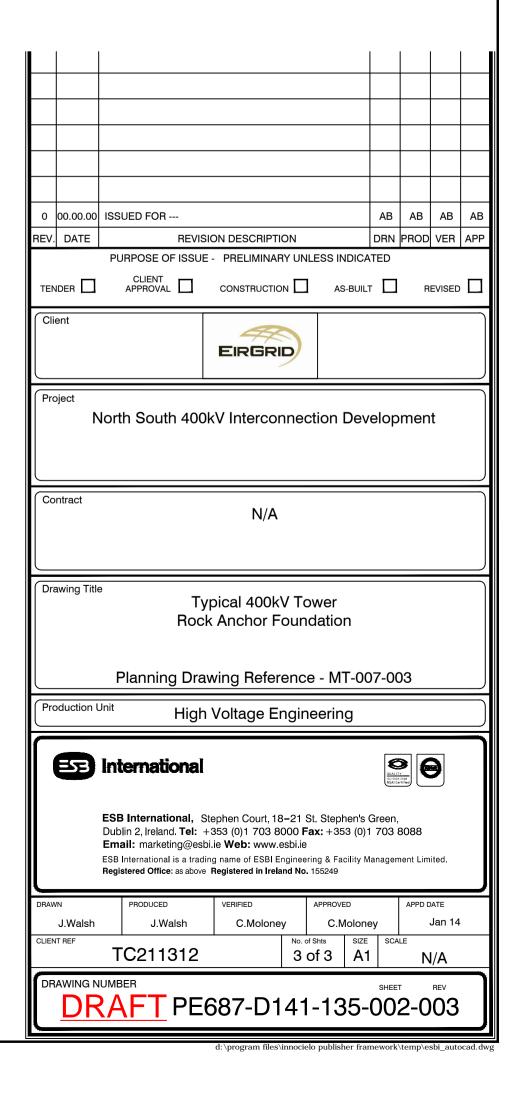

COPYRIGHT © ESBI ENGINEERING & FACILITY MANAGEMENT LIMITED.

All rights reserved. No part of this work may be modified or reproduced or copied in any form or by any means - graphic, electronic or mechanical, including photocopying, recording, taping or information-and-retrieval system, or used for any purpose other than its designated purpose, without the written permission of ESBI Engineering & Facility Management Ltd.