


0 50m 100m 150m 200m

LEGEND

Road		Proposed 400 kV Angle Tower Location
Land Parcel		Proposed 400 kV Intermediate Tower Location
Building		Outer Conductor
Stream / River		Centreline of Proposed Line Route
Townland Boundary		Outer Conductor
Existing Electricity Lines		Forestry
Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
Guarding Location - Temporary Works		Geo - Directory Point
		Marsh

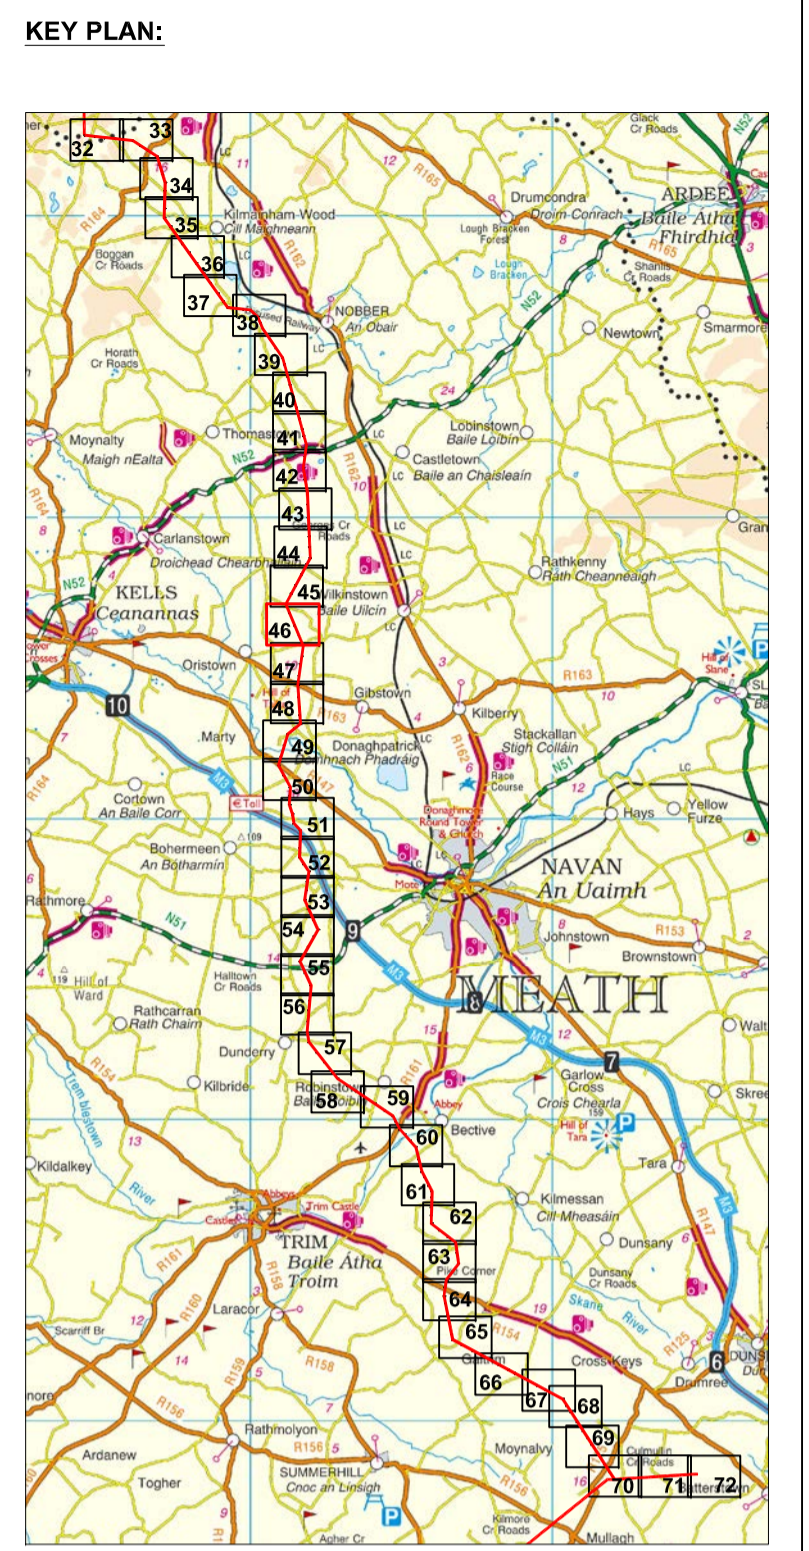

NOTES:

- Transmission lines and towers not to be scaled.
- For details of proposed structures see structure description schedule.
- Figured dimensions only to be taken from this drawing.
- Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2248, 2312

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project: NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title: MEATH STUDY AREA (MSA) 1:2,500 LINE ROUTE MAP - Sheet 46 of 72 -

Scale @ A1: 1:2,500

Prepared by: M. Nolan Checked: D. Grehan Date: December 2014

Project Director: D. Grehan

Planning Dwg Ref: MT-004-046

Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers, Block 10-4, Blanchardstown Corporate Park, Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and intended. Clients are advised to ensure that they have obtained the necessary permissions from the copyright holder, no part of this document may be reproduced or transmitted in any form and the document shall not be made open to any third party for any purpose.

Drawing No.: 6244-2025 Revision: **B**