


0 50m 100m 150m 200m

LEGEND

	Road		Proposed 400 kV Angle Tower Location
	Land Parcel		Proposed 400 kV Intermediate Tower Location
	Building		Outer Conductor
	Stream / River		Centreline of Proposed Line Route
	Townland Boundary		Outer Conductor
	Existing Electricity Lines		Forestry
	Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also)		Lake
	Guarding Location - Temporary Works		Geo - Directory Point
			Marsh

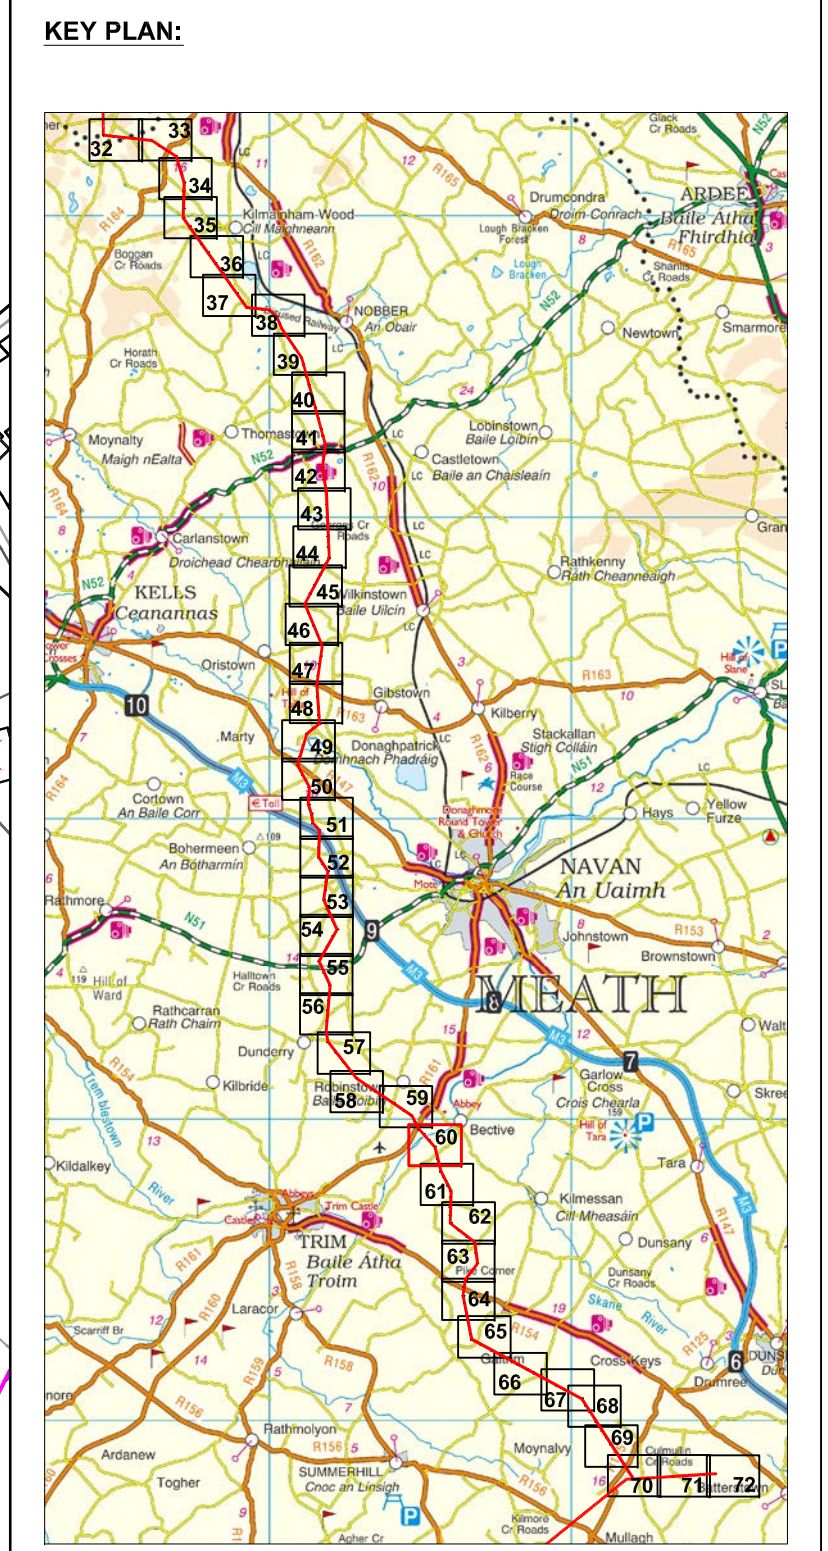

NOTES:

- Transmission lines and towers not to be scaled.
- For details of proposed structures see structure description schedule.
- Figured dimensions only to be taken from this drawing.
- Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.

OSI Sheet(s): 2642-C, 2642-D, 2712-A, 2712

DRAFT

Rev	Date	Description	By	Chkd.
B	Dec. '14	PLANNING ISSUE	M.N	D.G.
A	Jan. '14	CLIENT ISSUE	MN	DG

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 60 of 72 -**

Scale @ A1: **1:2,500**

Prepared by: M. Nolan Checked: D. Grehan Date: December 2014

Project Director: D. Grehan

Planning Dwg Ref: MT-004-060

TOBIN
Patrick J. Tobin & Co. Ltd.

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)1-8030406
fax: +353-(0)1-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

TOBIN Consulting Engineers will not be liable for any use of this document for any purpose other than that for which it was originally prepared and intended. Clients are advised to ensure that they are satisfied with the content of this document before it is used for any purpose. TOBIN Consulting Engineers, as copyright holder, no part of this document may be reproduced or transmitted in any form and the document shall not be made open to any third party for any purpose.

Drawing No.: **6244-2039** Revision: **B**