


KEY PLAN:

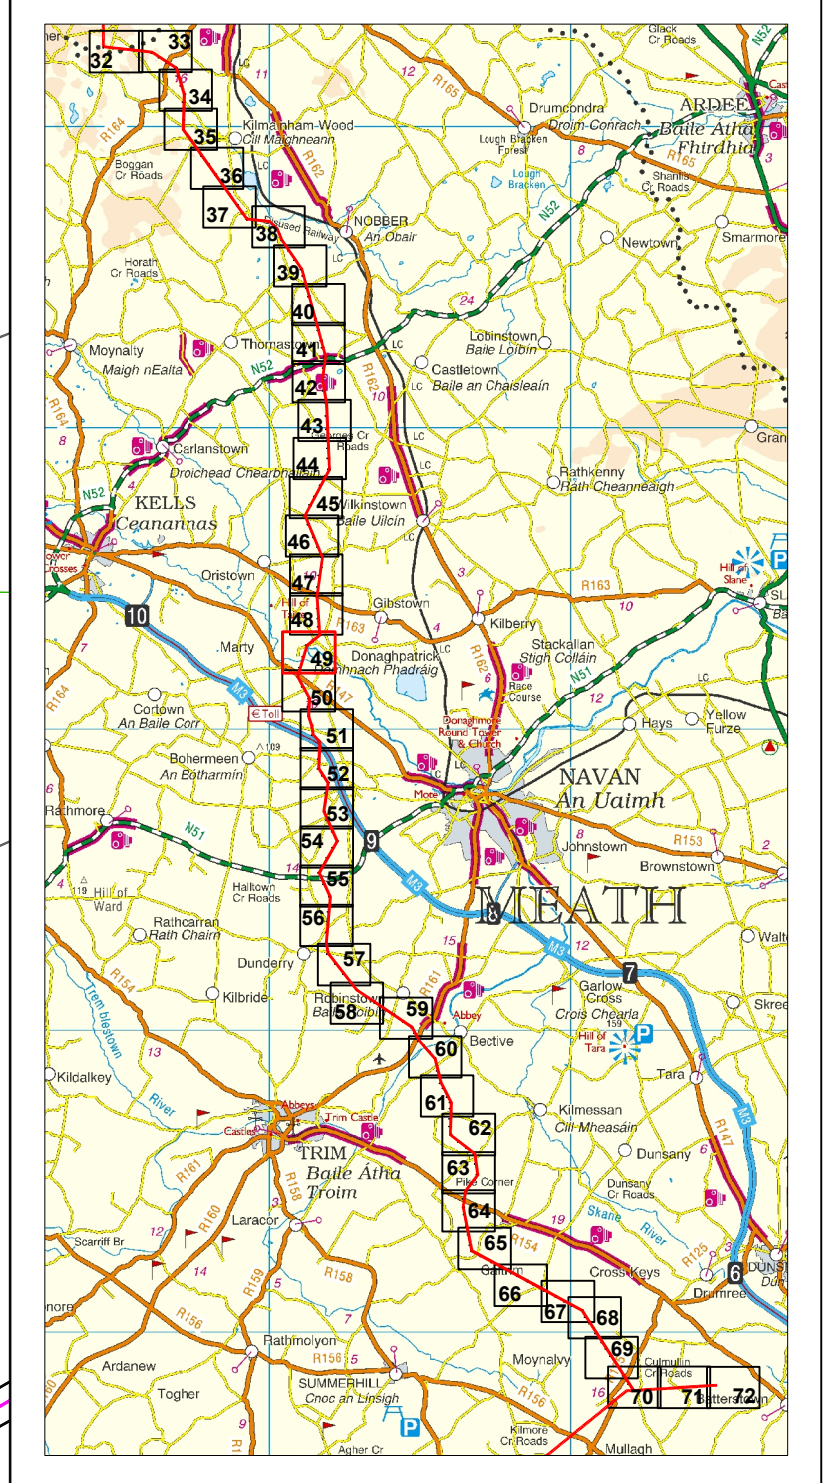

- NOTES:**
1. Transmission lines and towers not to be scaled.
 2. For details of proposed structures see structure description schedule.
 3. Figured dimensions only to be taken from this drawing.
 4. Dimensions are shown from nearest point of dwelling to the centreline of proposed line route and nearest outer conductor.
- OSI Sheet(s): 2375, 2375-A, 2375-C

| Rev | Date | Description | By | Chkd. |
|-----|----------|--------------------------------|-----|-------|
| C | Feb. '15 | UPDATE FOLLOWING DESIGN REVIEW | MN | DG |
| B | Dec. '14 | PLANNING ISSUE | M.N | D.G. |
| A | Jan. '14 | CLIENT ISSUE | MN | DG |

Client:

Project:

NORTH - SOUTH 400 kV INTERCONNECTION DEVELOPMENT

Title:

**MEATH STUDY AREA (MSA)
1:2,500 LINE ROUTE MAP
- Sheet 49 of 72 -**

Scale @ A1: **1:2,500**

| | | |
|------------------------------|-----------|---------------|
| Prepared by: | Checked: | Date: |
| M. Nolan | D. Grehan | February 2015 |
| Project Director: D. Grehan | | |
| Planning Dwg Ref: MT-004-049 | | |

TOBIN Consulting Engineers,
Block 10-4, Blanchardstown Corporate Park,
Dublin 15, Ireland.
tel: +353-(0)11-8030406
fax: +353-(0)11-8030409
e-mail: dublin@tobin.ie
www.tobin.ie

Drawing No.: **6244-2028**

Revision: **C**

0 50m 100m 150m 200m

LEGEND

| | | | |
|--|---|--|---|
| | Road | | Proposed 400 kV Angle Tower Location |
| | Land Parcel | | Proposed 400 kV Intermediate Tower Location |
| | Building | | Outer Conductor |
| | Stream / River | | Centreline of Proposed Line Route |
| | Townland Boundary | | Outer Conductor |
| | Existing Electricity Lines | | Forestry |
| | Distance to Existing Dwelling / Planning Permission within 200m of centreline (See note 4 also) | | Lake |
| | Guarding Location - Temporary Works | | Geo - Directory Point |
| | Proposed Alterations to Existing Electricity Line | | Marsh |