

Ballymargy

HANSLOUGH ROAD

18


19

Weir

Sinks

15

This material is based upon Crown Copyright and is reproduced with the permission of Land & Property Services under delegated authority from the Controller of Her Majesty's Stationery Office. © Crown Copyright & database rights FLA213. Unauthorised reproduction infringes © Crown copyright and may lead to prosecution or civil proceedings.

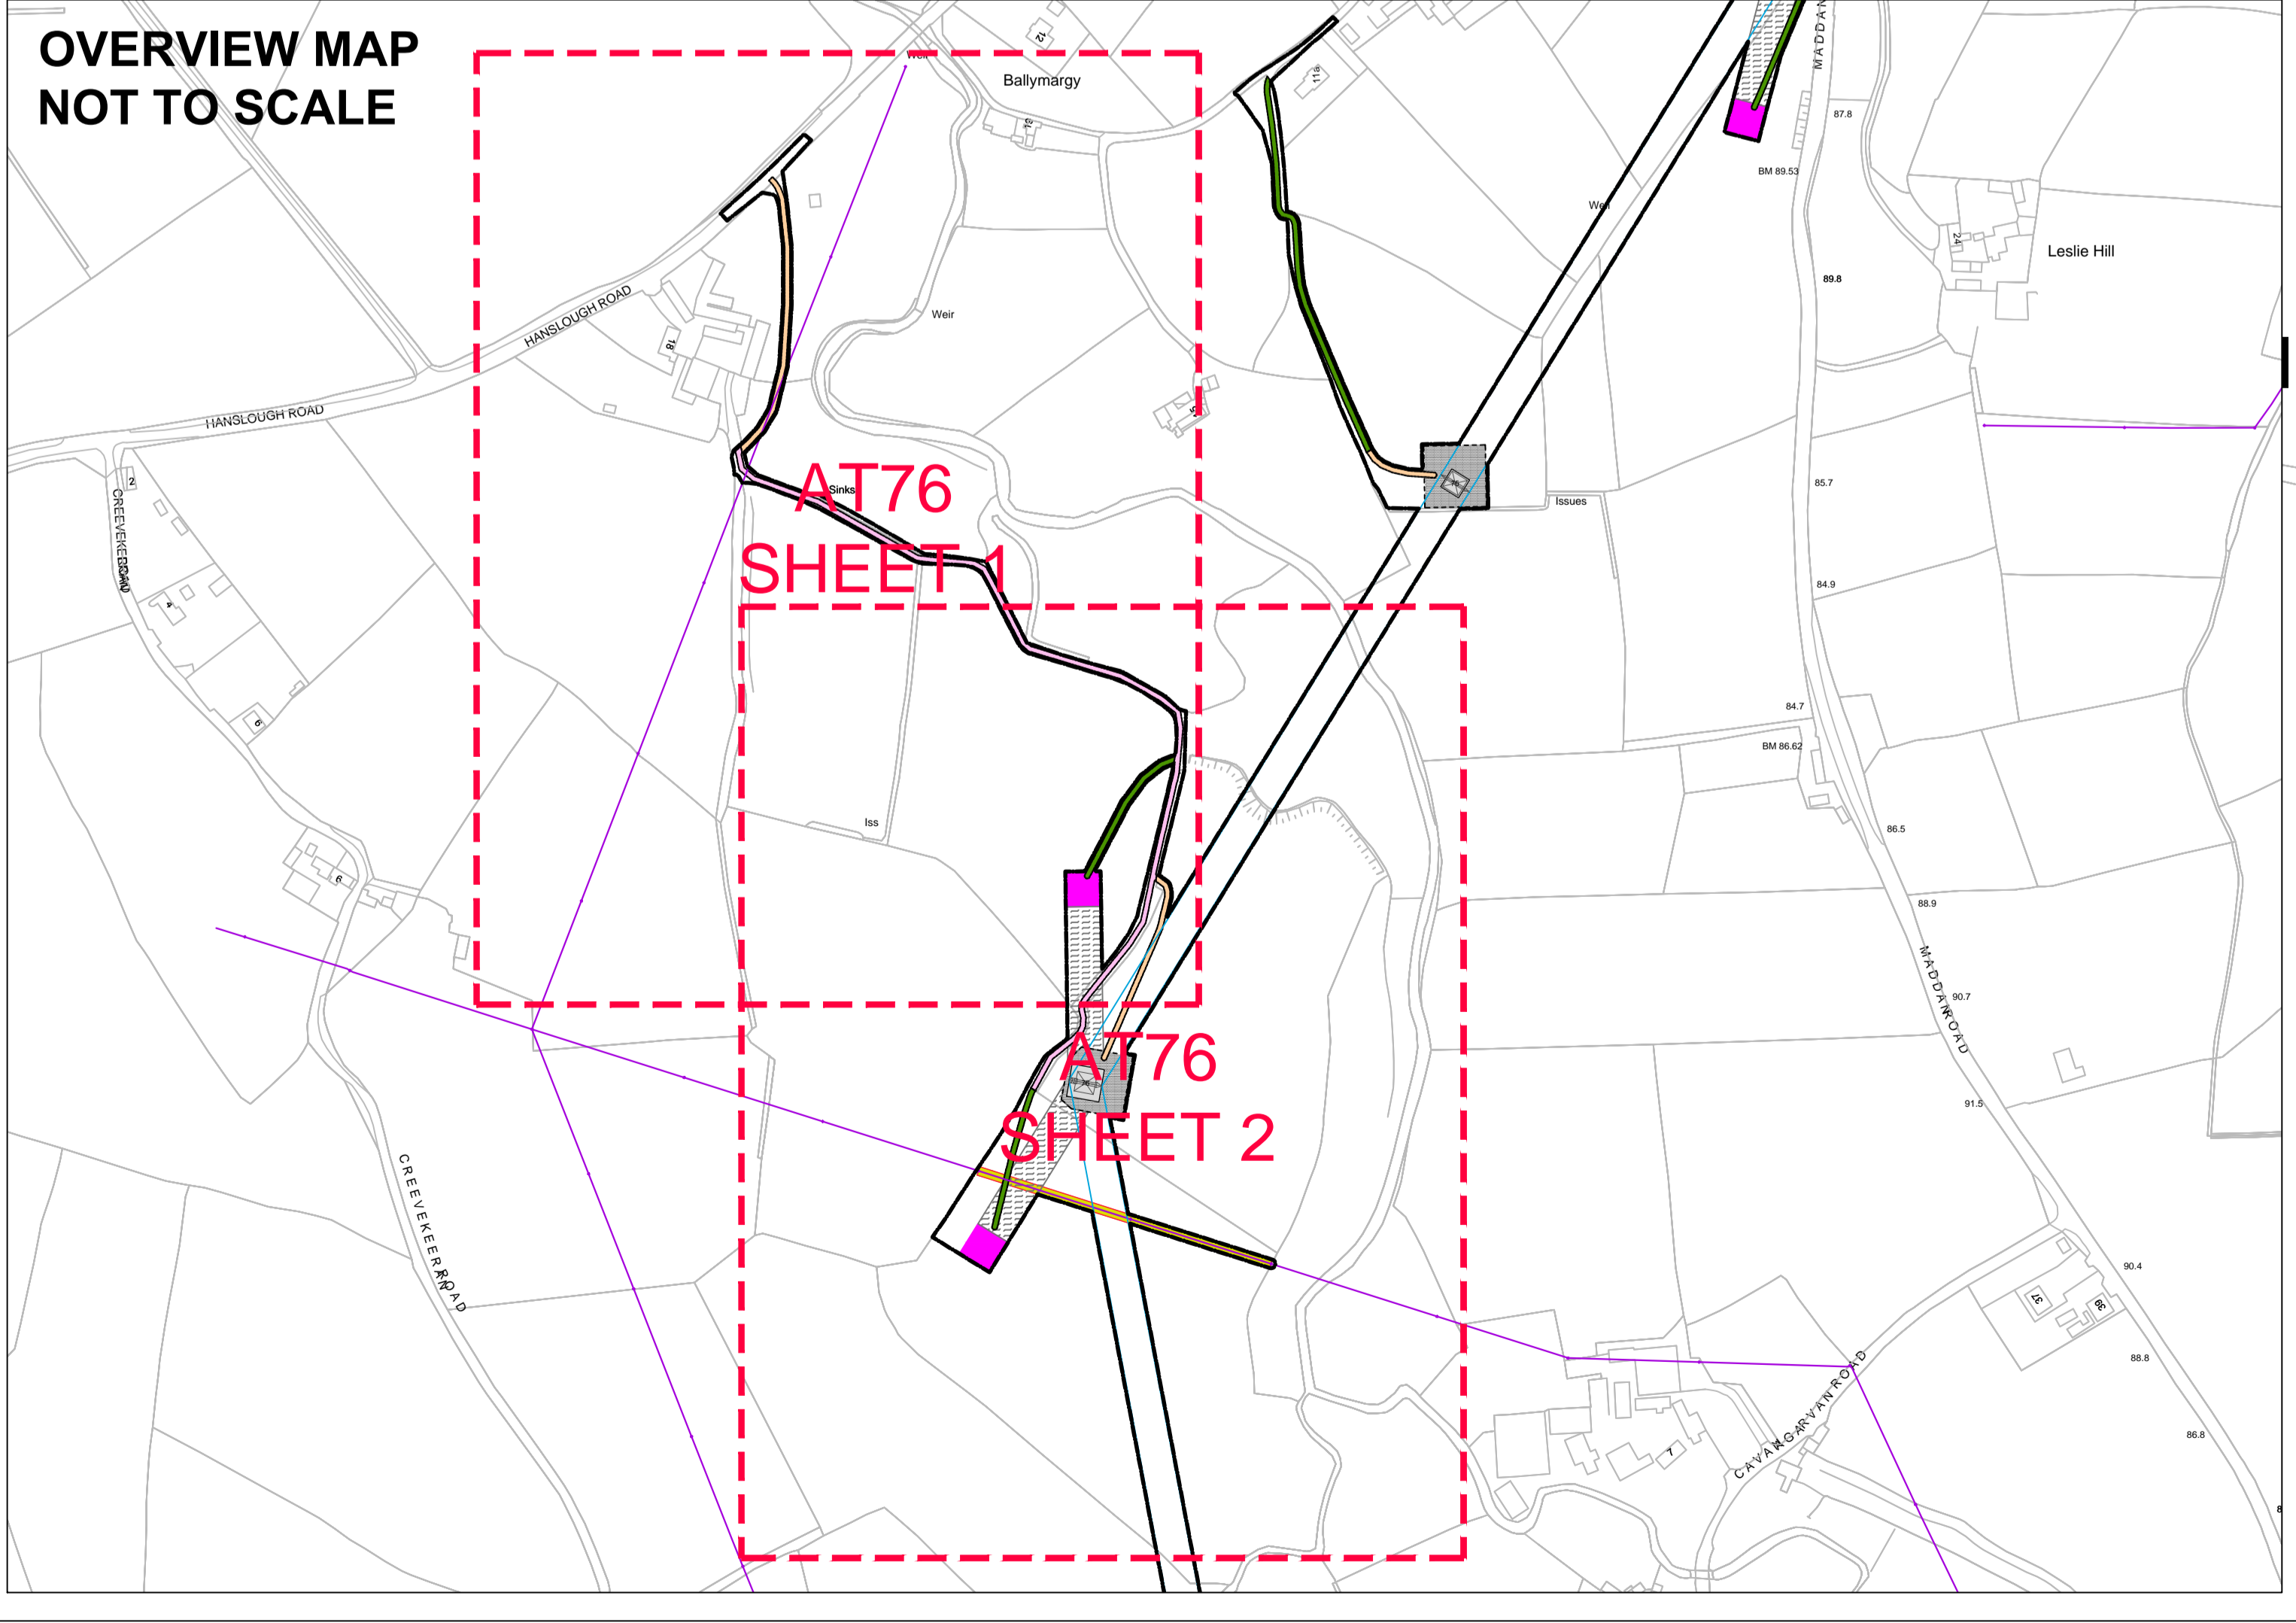

- LEGEND**
- Proposed Substation Site
 - Proposed Tower and Maximum Tower Foundation
 - Proposed 400kV Overhead Line
 - Proposed Working Area (Temporary Fencing) (35 x 35m or 1225 sq.m)
 - Proposed Stringing Position
 - Stringing Position Corridor
 - Proposed Stone
 - Existing Stone / Lane
 - Existing Concrete
 - Grass / Unimproved
 - Existing Tarmac
 - Temporary Guarding Location
 - Guarding Location Access Track
 - Planning Application Boundary
 - Existing 11kV Pole
 - Existing 33kV Pole
 - Existing 11kV Conductor
 - Existing 33kV Conductor
 - Proposed Undergrounding of Existing LV Network Section
 - Existing LV Network
 - Undergrounding Access Track

Client: 

Project: TYRONE TO CAVAN INTERCONNECTOR

Title: TYRONE TO CAVAN
400kV INTERCONNECTOR PROJECT

ACCESS TRACK 76 AT 1:500 SCALE
SHEET 1 OF 2

| | |
|---------------------------|-------------------|
| Design: MH | Drawn: KR |
| Checked: NIE | App'd: NIE |
| Date: 10/04/2013 | Scale: 1:500 @ A0 |
| No. 60032220/3528/AT 76/1 | |