



Notes:
Foundation width to be no greater than maximum generic dimensions, not larger than 20 x 20m (total width).

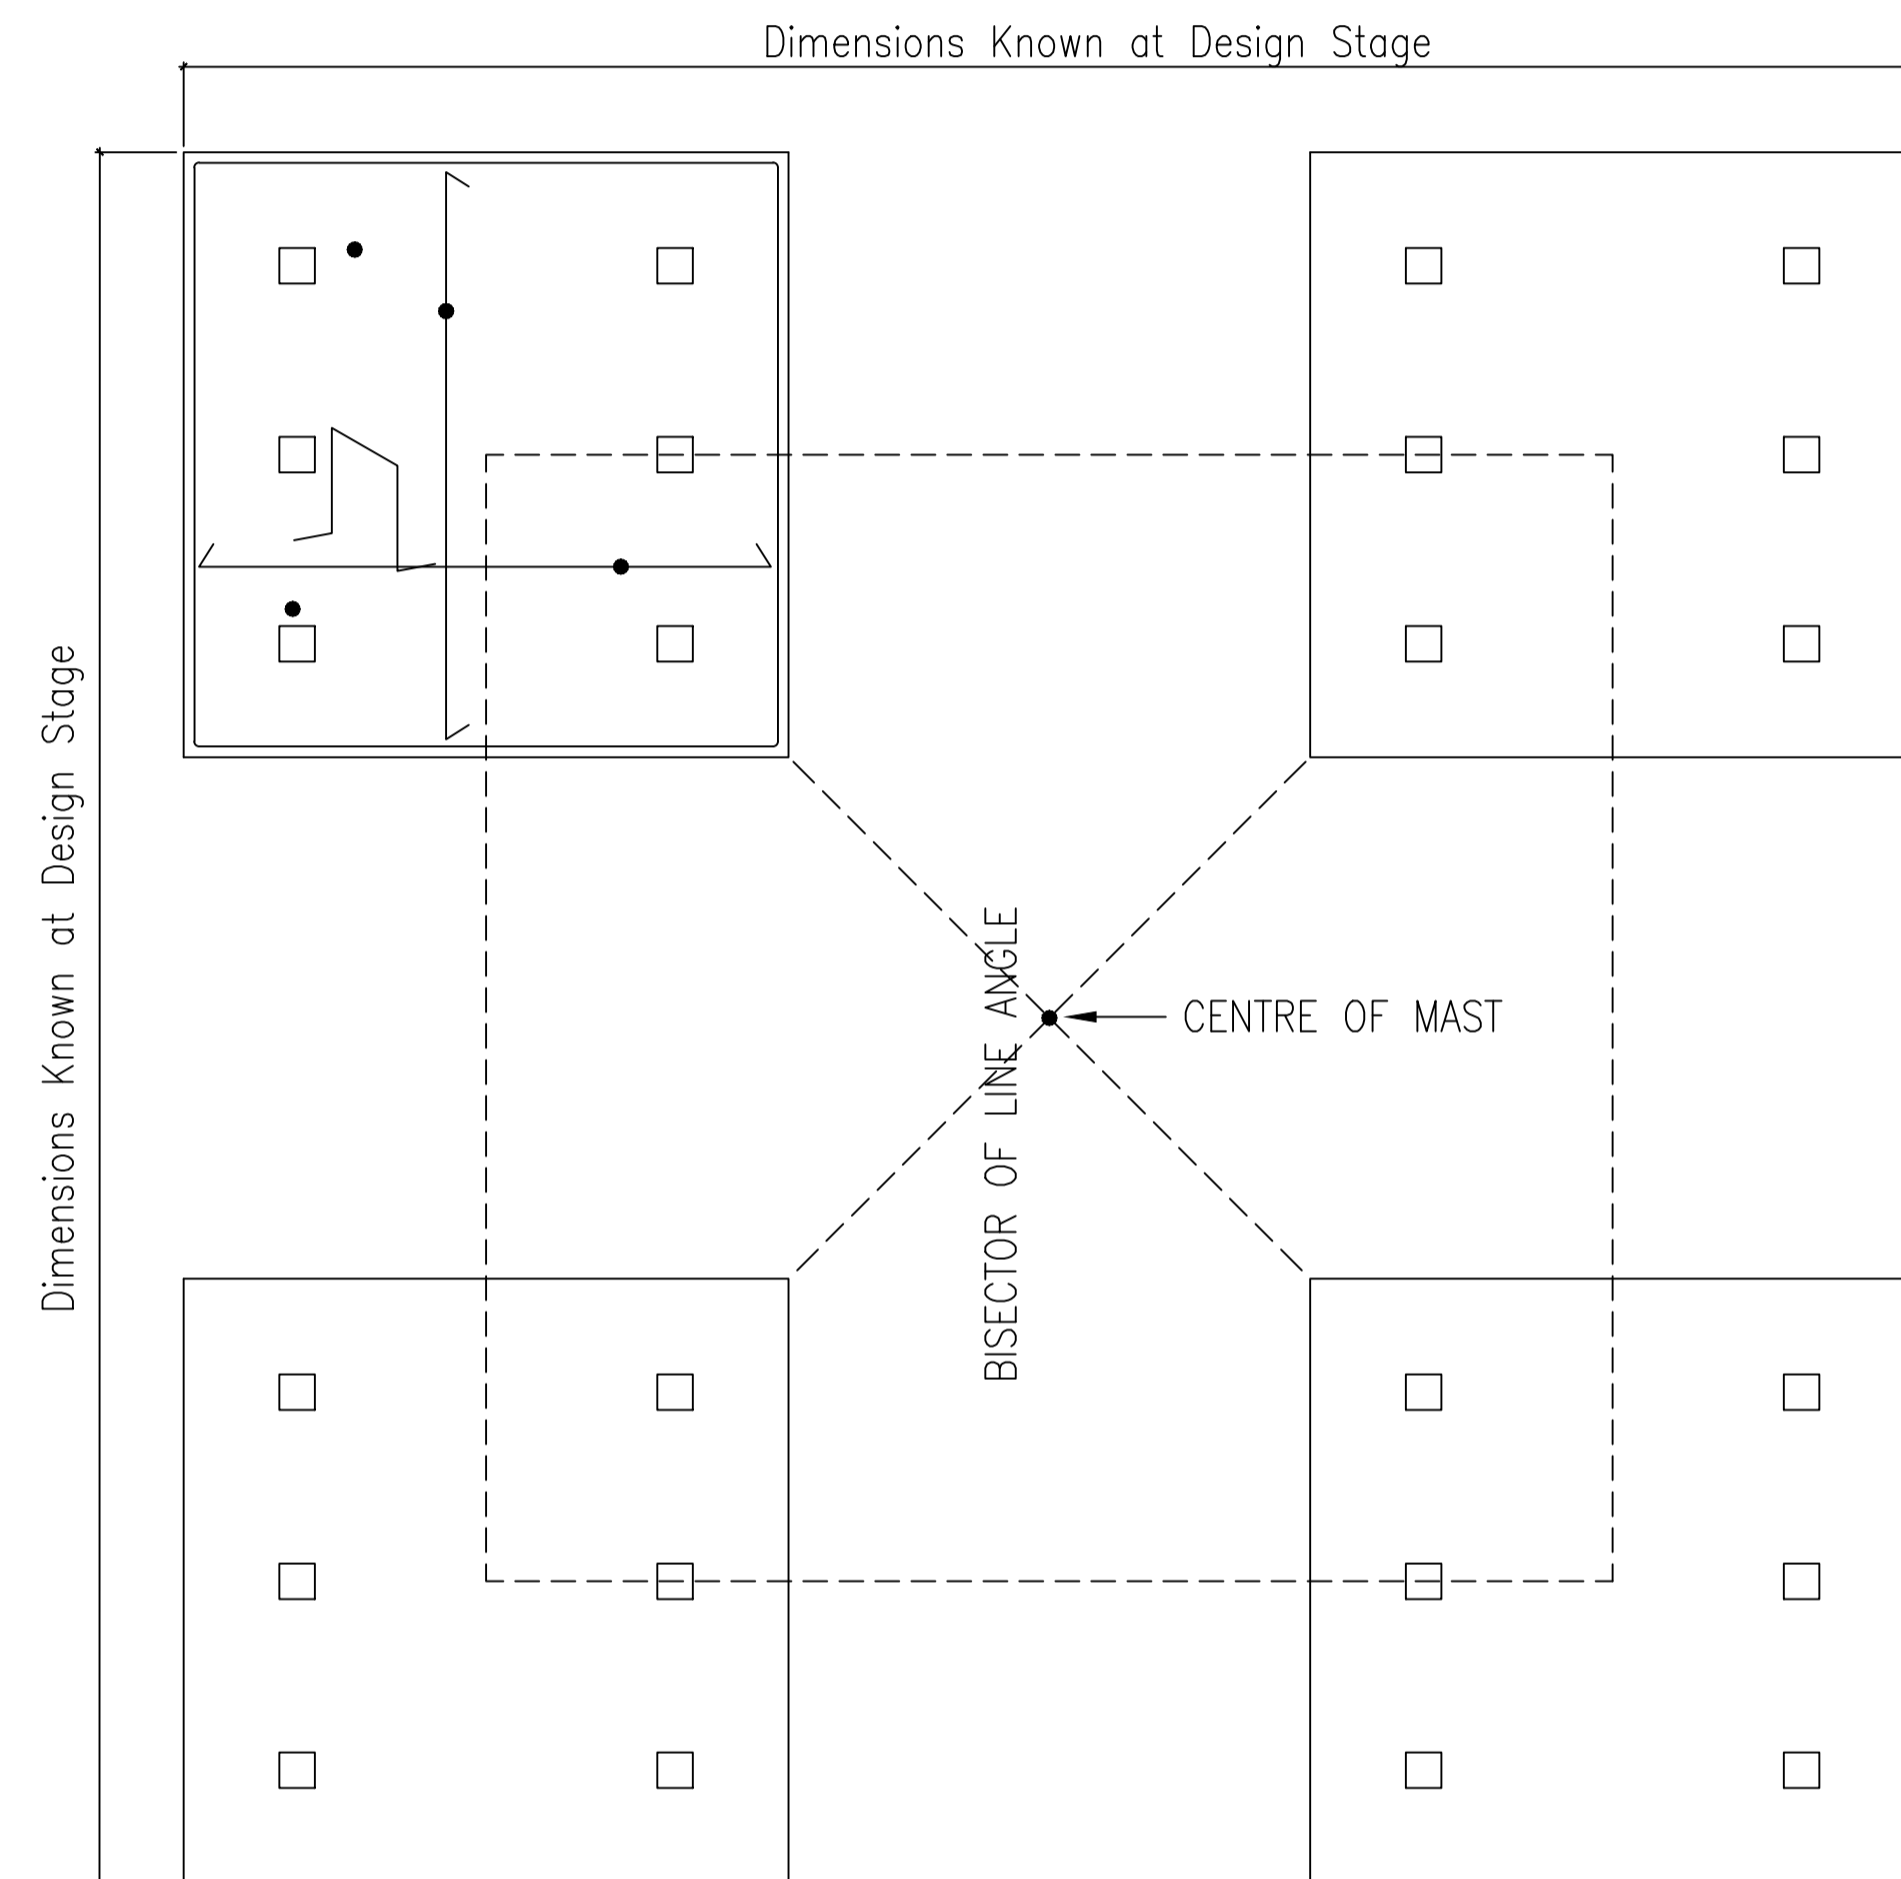

PLAN OF PILE CAP REINFORCEMENT
SCALE 1:50

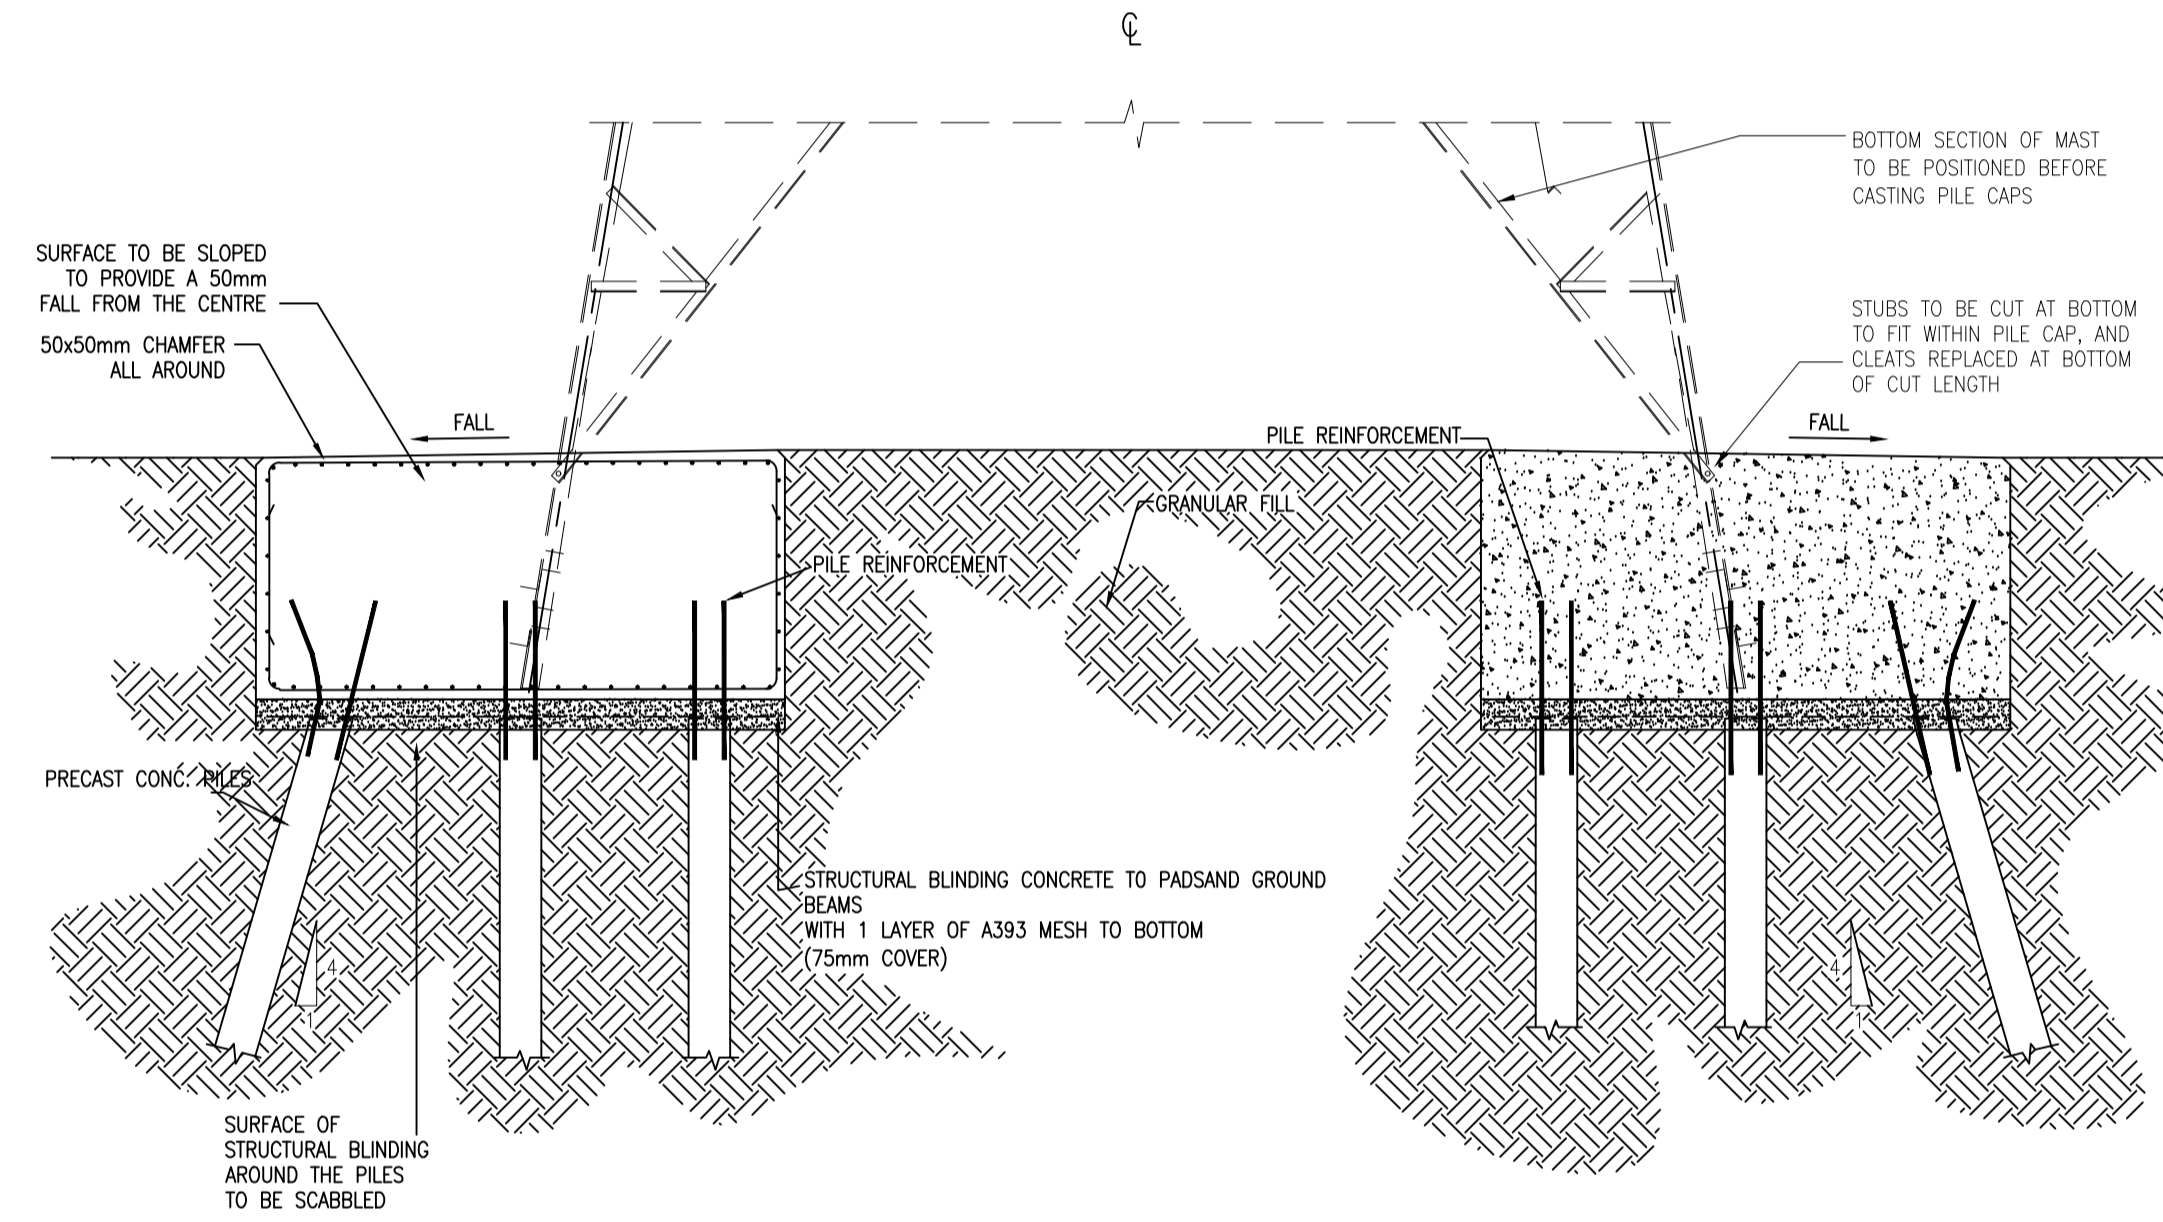

SECTION A
SCALE 1:50

Foundation Width	(m) Min	(m) Max
400kV SC Int	2.2	3.7
400kV SC 30	3.8	7.3
400kV SC 60	4.9	8.1
400kV SC 90	5.1	8.8

0	00.00.00	ISSUED FOR ---	AB	AB	AB	AB
REV	DATE	REVISION DESCRIPTION	DRN	VER	APP	
PURPOSE OF ISSUE - PRELIMINARY UNLESS INDICATED						
TENDER	<input type="checkbox"/>	CLIENT APPROVAL	<input type="checkbox"/>	CONSTRUCTION	<input type="checkbox"/>	AS-BUILT
	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	REVISED
Client	N.I.E.					
Project	Tyrone - Cavan 400kV Interconnector					
Contract						
Drawing Title	Pile Foundation Layout for 400kV Tower					
Production Unit	High Voltage Engineering					
<p>ESB International ESBI Engineering & Facility Management Ltd. Stephen Court, 18/21 St Stephen's Green, Dublin 2, Ireland Telephone +353-1-703 8000 Fax +353-1-661-6600 Website www.esbi.ie Registered Office as above Registered in Ireland No. 155249</p>						
DRAWN	JW	VERIFIED	CM	APPROVED	JD	APPO DATE
						April 2013
CLIENT REF		No. of Sheets	A1	REV		SCALE
						As Shown
DRAWING NUMBER						
PE687-D141-080-003-000						