



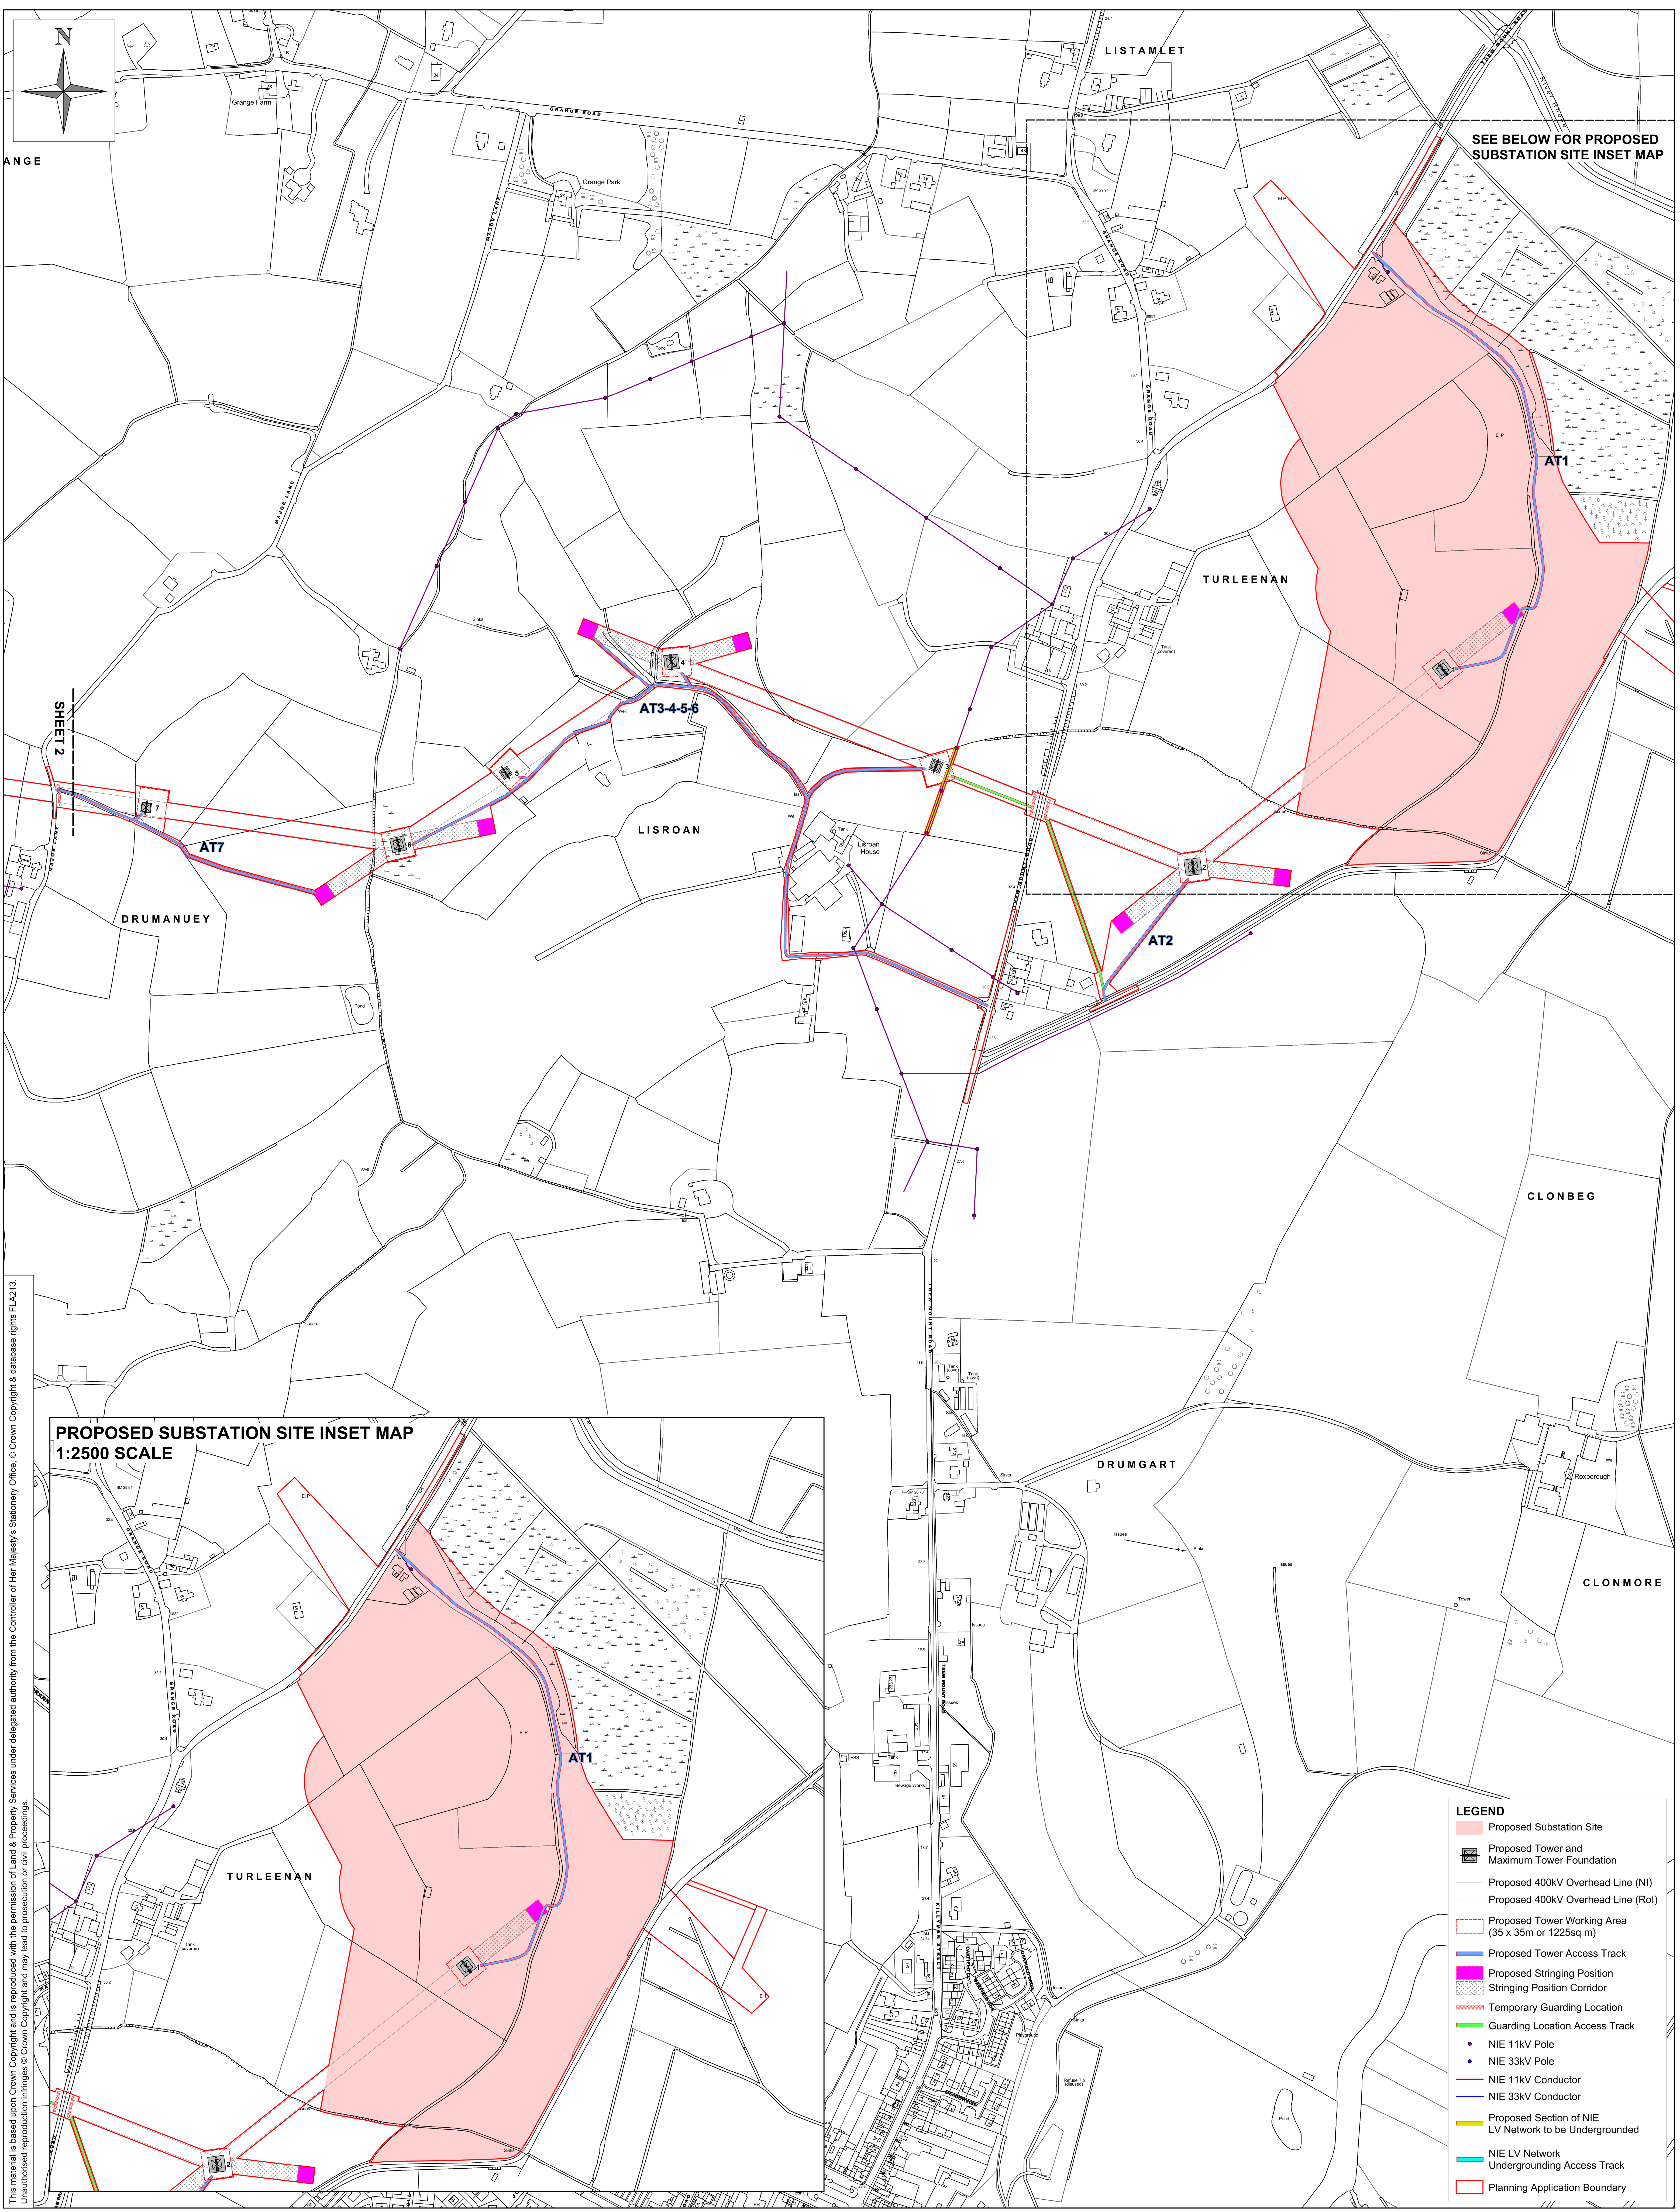

This material is based upon Crown Copyright and is reproduced with the permission of Land & Property Services under delegated authority from the Controller of Her Majesty's Stationery Office. © Crown Copyright & database rights FLA213. Unauthorised reproduction infringes © Crown Copyright and may lead to prosecution or civil proceedings.

**PROPOSED SUBSTATION SITE INSET MAP  
1:2500 SCALE**

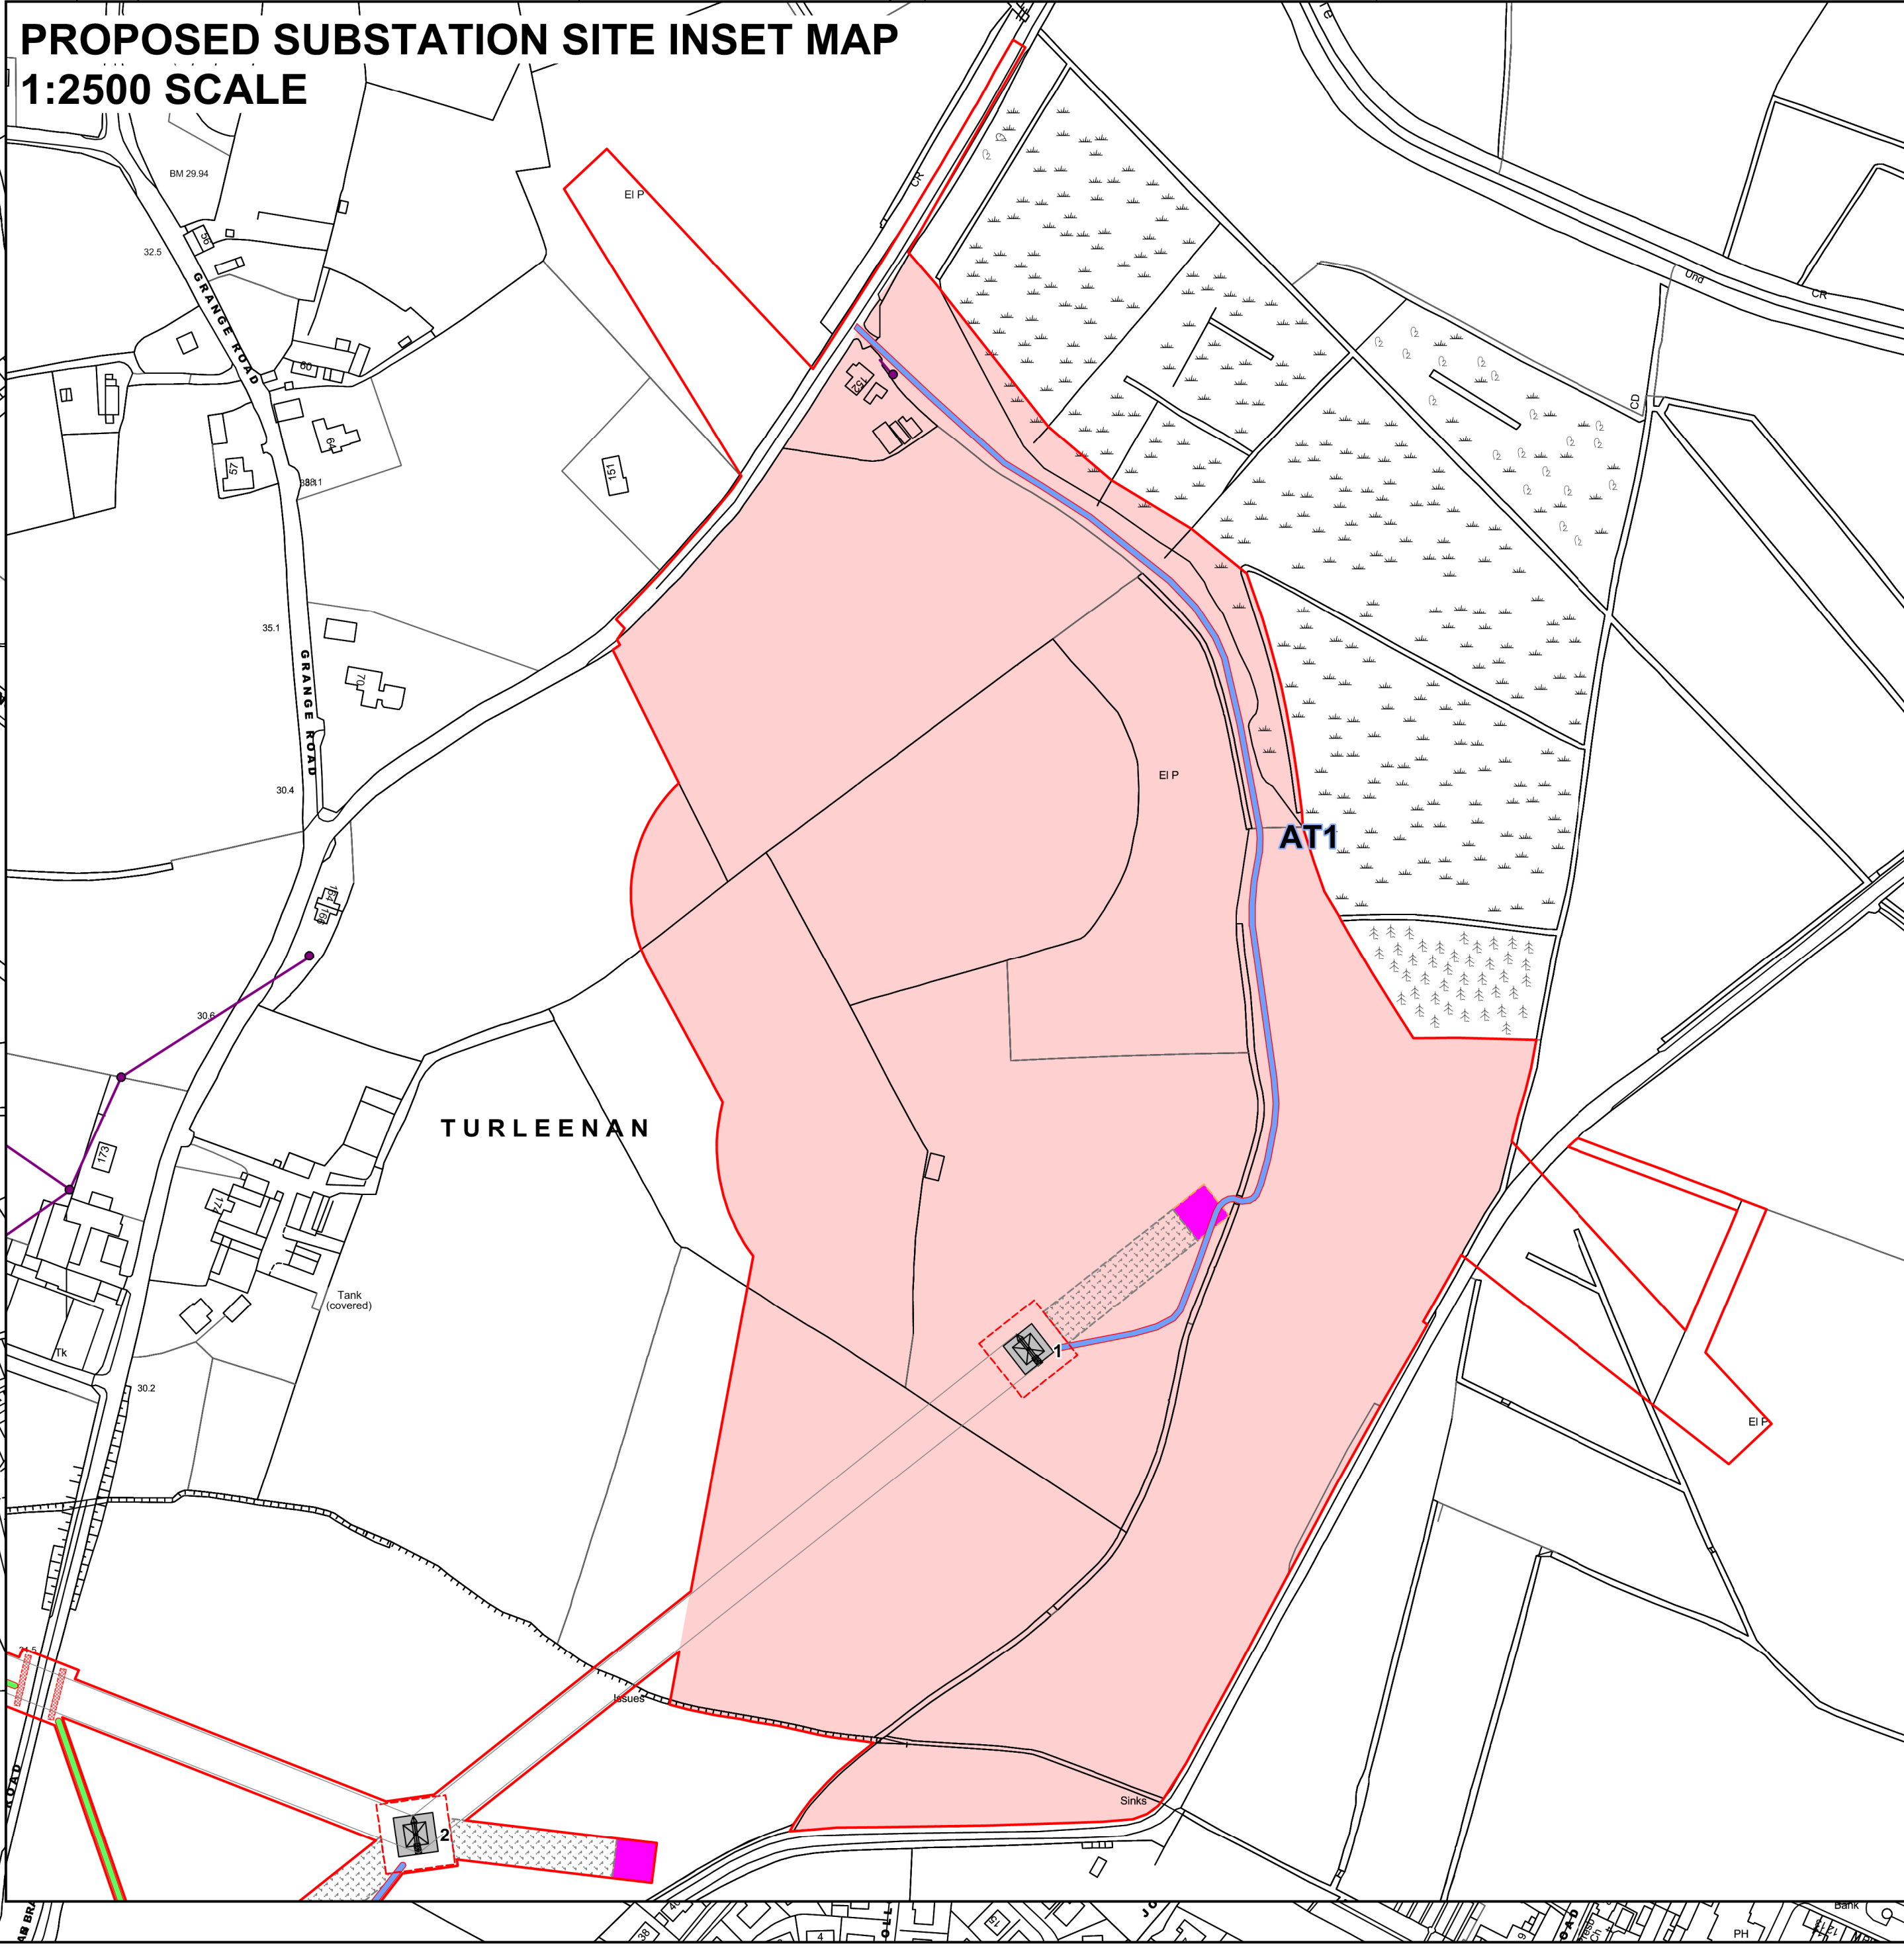

- LEGEND**
- Proposed Substation Site
  - Proposed Tower and Maximum Tower Foundation
  - Proposed 400kV Overhead Line (NI)
  - Proposed 400kV Overhead Line (RoI)
  - Proposed Tower Working Area (35 x 35m or 1225sq m)
  - Proposed Tower Access Track
  - Proposed Stringing Position
  - Stringing Position Corridor
  - Temporary Guarding Location
  - Guarding Location Access Track
  - NIE 11kV Pole
  - NIE 33kV Pole
  - NIE 11kV Conductor
  - NIE 33kV Conductor
  - Proposed Section of NIE LV Network to be Undergrounded
  - NIE LV Network
  - Undergrounding Access Track
  - Planning Application Boundary

Client: 

Project: TYRONE TO CAVAN INTERCONNECTOR

Title: TYRONE TO CAVAN  
400kV INTERCONNECTOR PROJECT  
ASSOCIATED WORKS SITE LOCATION PLAN  
SHEET 1 OF 13

|                         |                    |
|-------------------------|--------------------|
| Design: MH              | Drawn: GB          |
| Chk'd: NIE              | App'd: NIE         |
| Date: 15/04/2013        | Scale: 1:2500 @ A0 |
| No: 60032220/3528/04/01 |                    |