
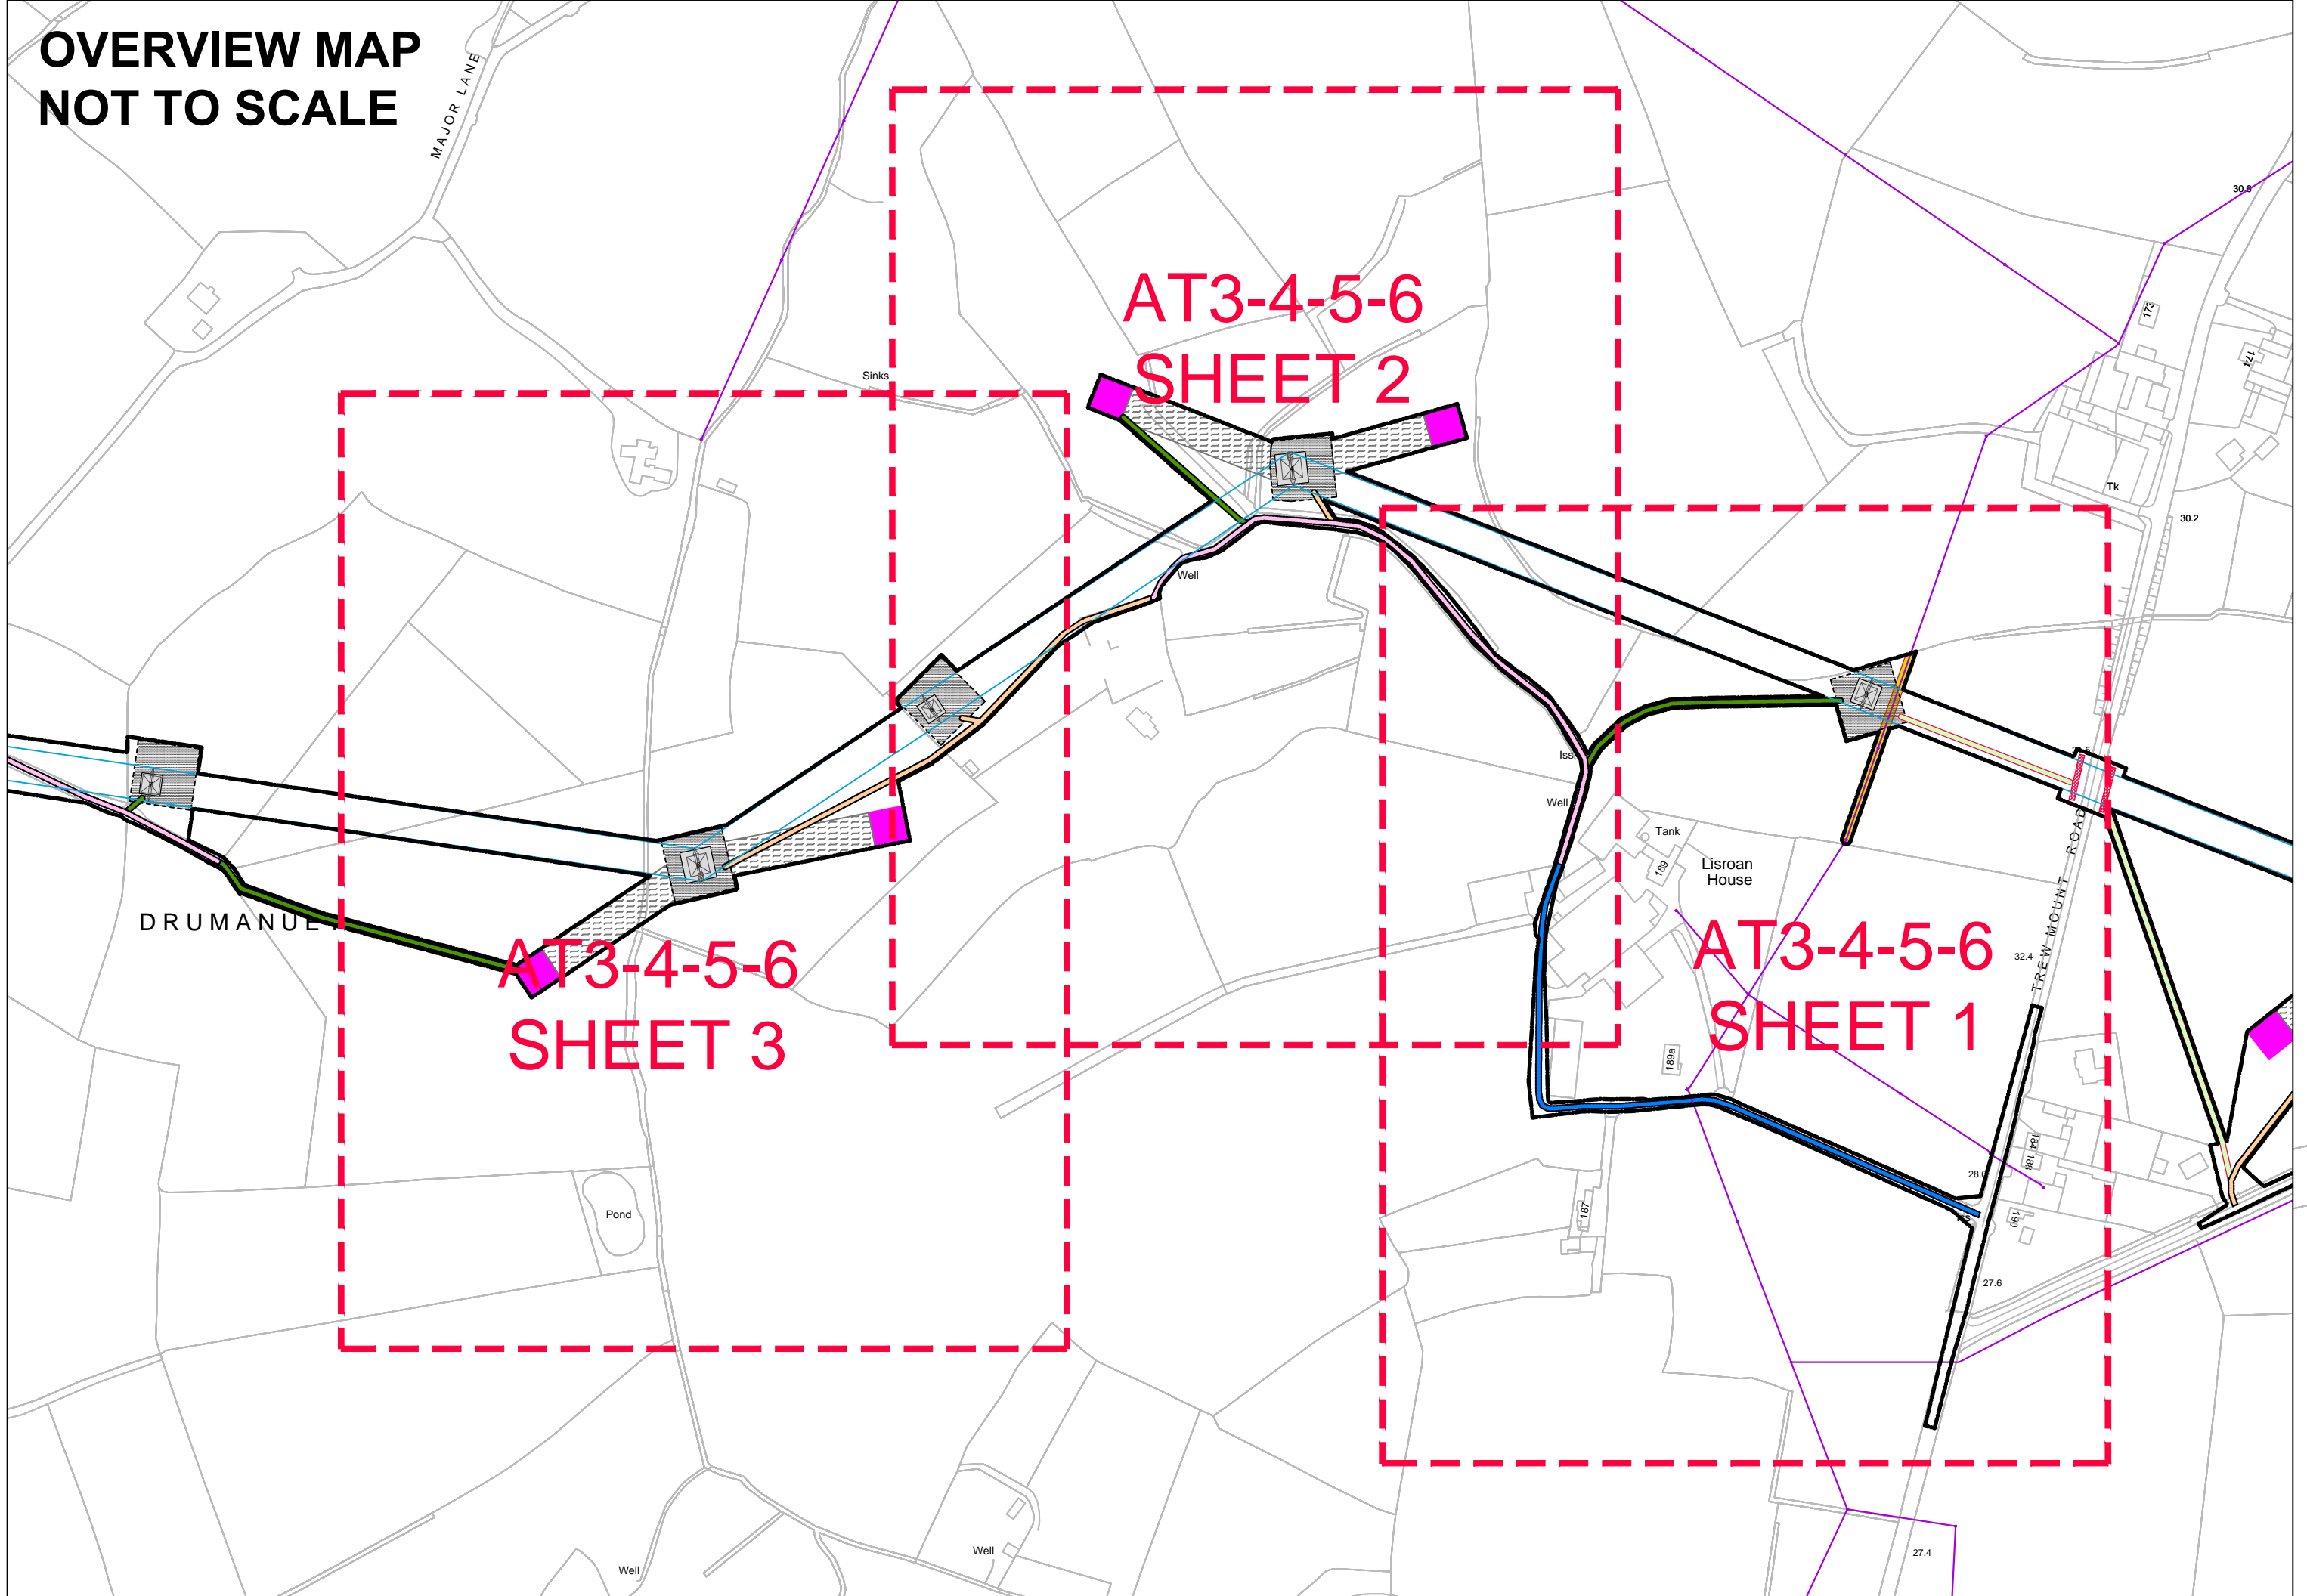


This material is based upon Crown Copyright and is reproduced with the permission of Land & Property Services under delegated authority from the Controller of Her Majesty's Stationery Office. © Crown Copyright & database rights FLA213. Unauthorised reproduction infringes © Crown copyright and may lead to prosecution or civil proceedings.

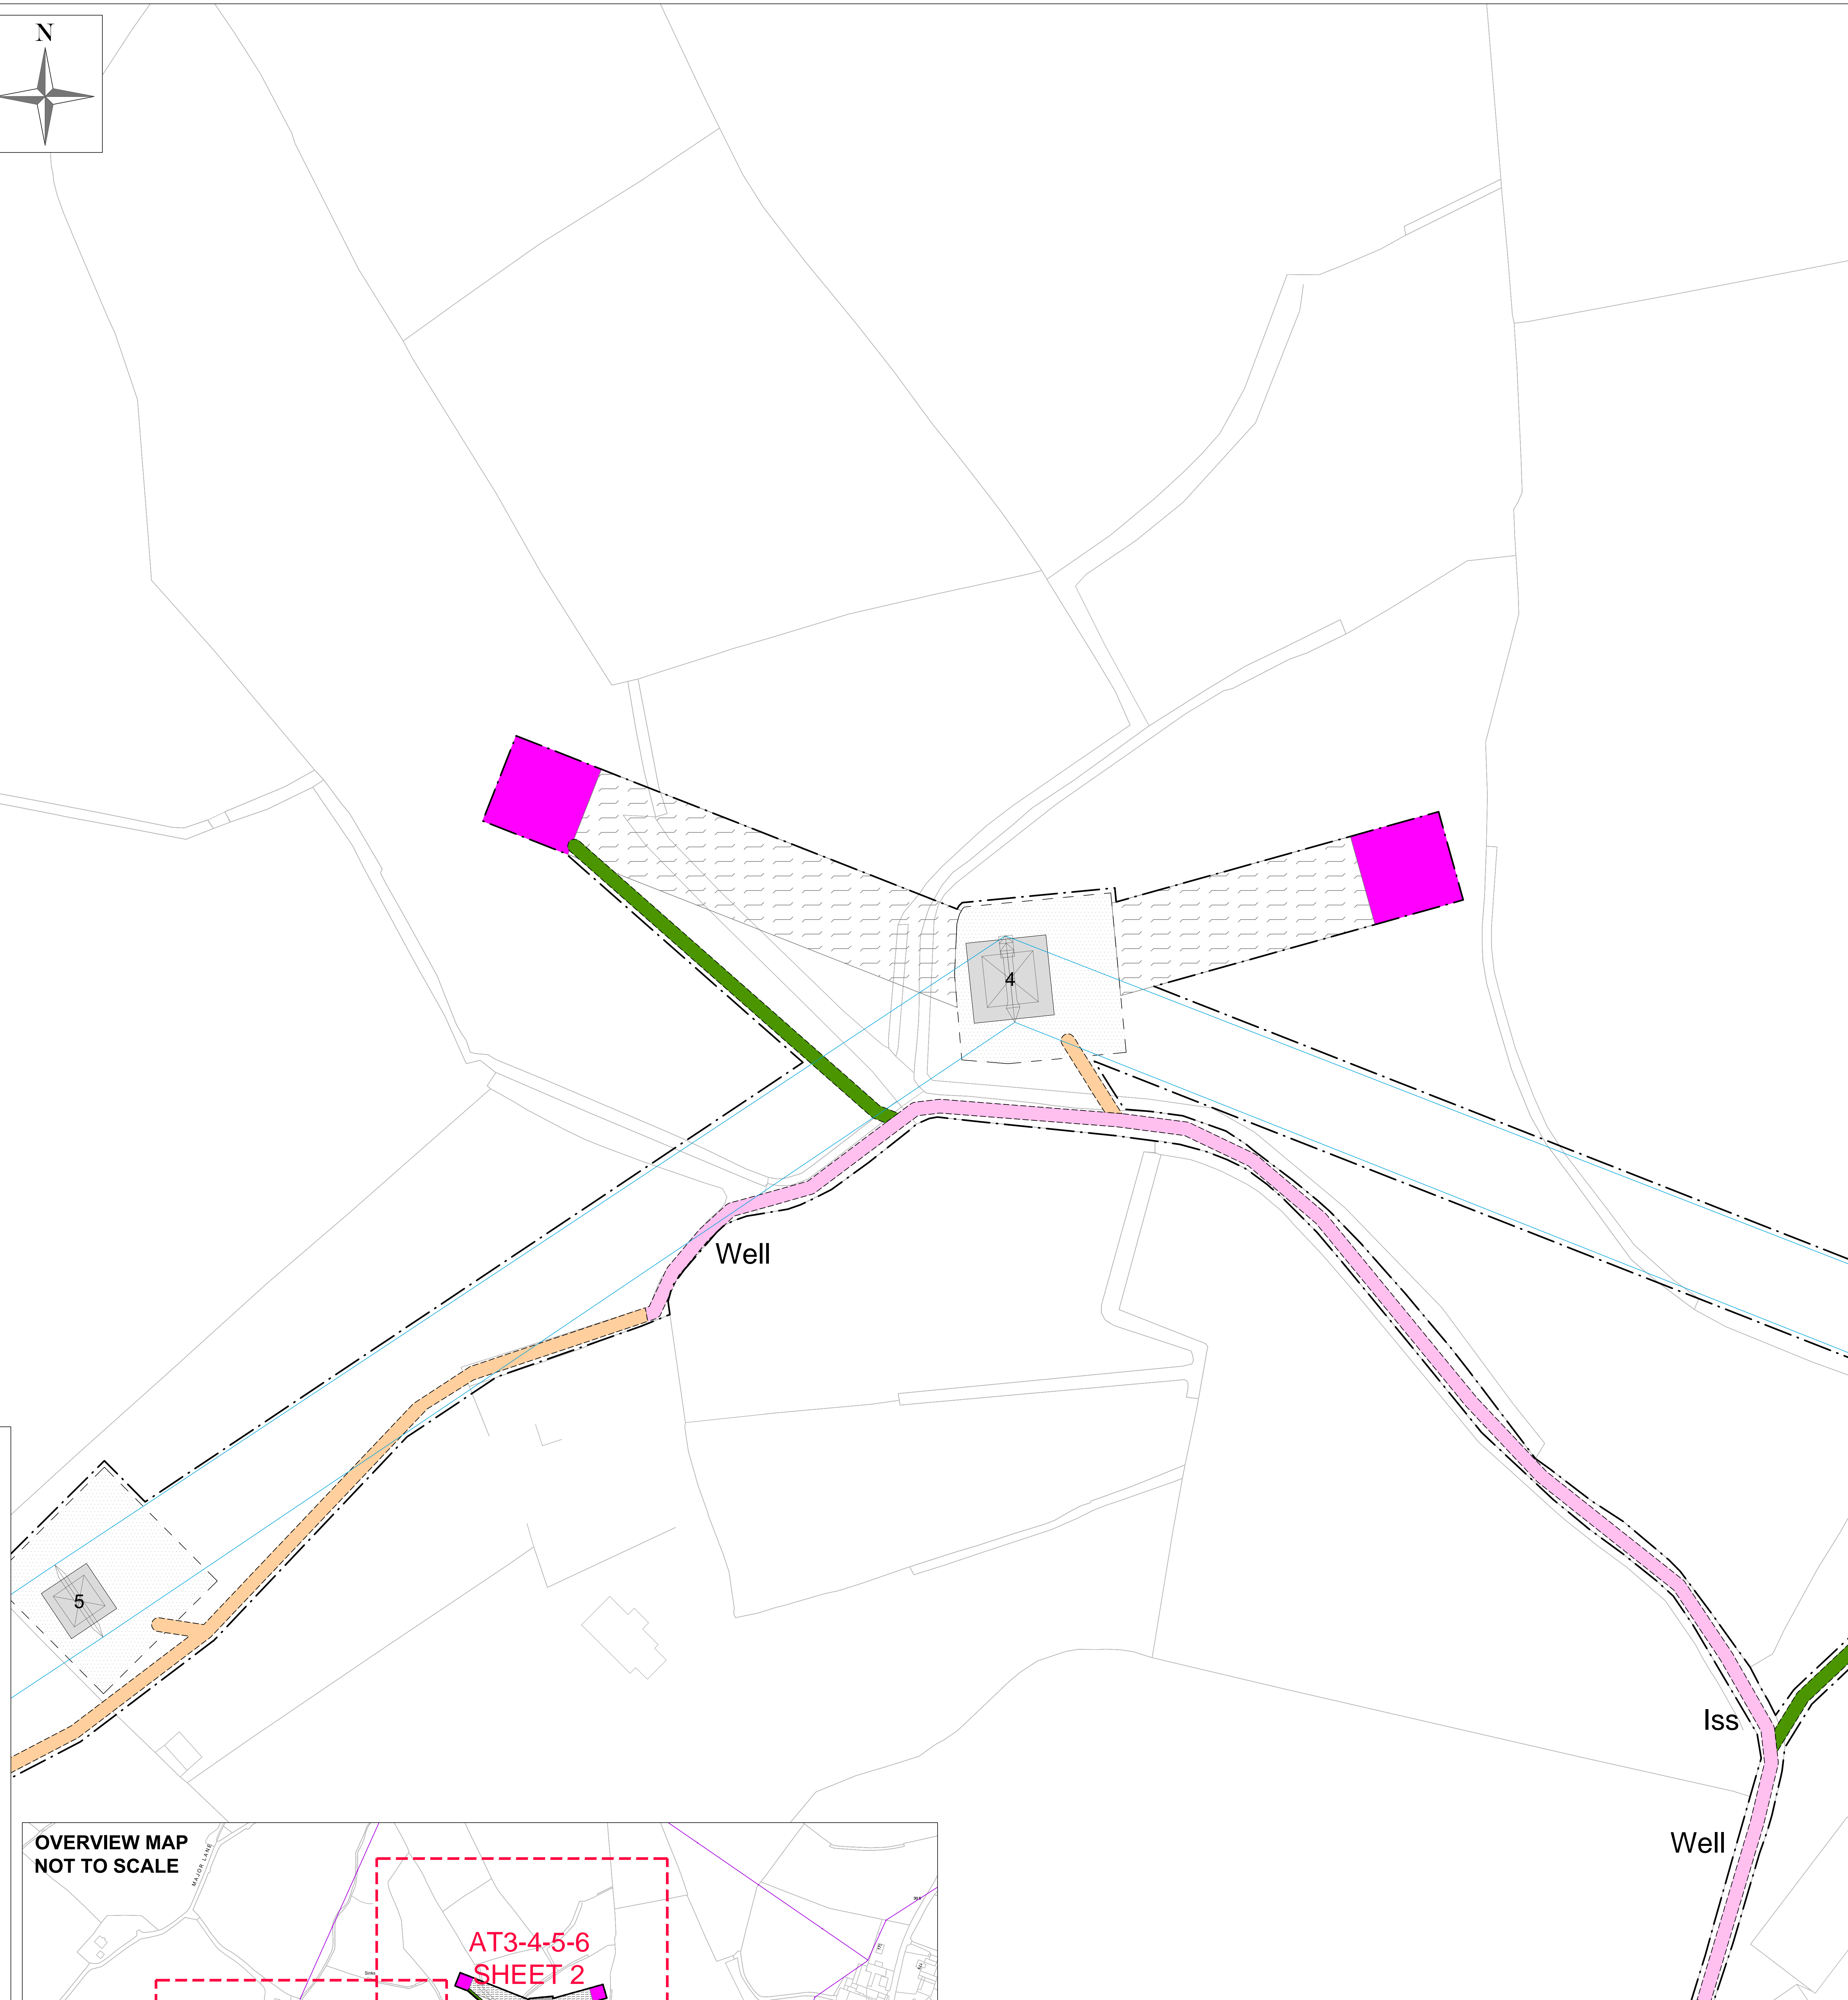

| LEGEND | |
|--------|---|
| | Proposed Substation Site |
| | Proposed Tower and Maximum Tower Foundation |
| | Proposed 400kV Overhead Line |
| | Proposed Working Area (Temporary Fencing) (35 x 35m or 1225 sq.m) |
| | Proposed Stringing Position |
| | Stringing Position Corridor |
| | Proposed Stone |
| | Existing Stone / Lane |
| | Existing Concrete |
| | Grass / Unimproved |
| | Existing Tarmac |
| | Temporary Guarding Location |
| | Guarding Location Access Track |
| | Planning Application Boundary |
| | Existing 11kV Pole |
| | Existing 33kV Pole |
| | Existing 11kV Conductor |
| | Existing 33kV Conductor |
| | Proposed Undergrounding of Existing LV Network Section |
| | Existing LV Network Undergrounding Access Track |

Client:  Northern Ireland Electricity

Project: TYRONE TO CAVAN INTERCONNECTOR

Title: TYRONE TO CAVAN
400kV INTERCONNECTOR PROJECT

ACCESS TRACK 3-4-5-6 AT 1:500 SCALE
SHEET 2 OF 3

| | |
|-------------------------------|-------------------|
| Design: MH | Drawn: KR |
| Checked: NIE | App'd: NIE |
| Date: 10/04/2013 | Scale: 1:500 @ A0 |
| No. 60032220/3528/AT3-4-5-6/2 | |