




North

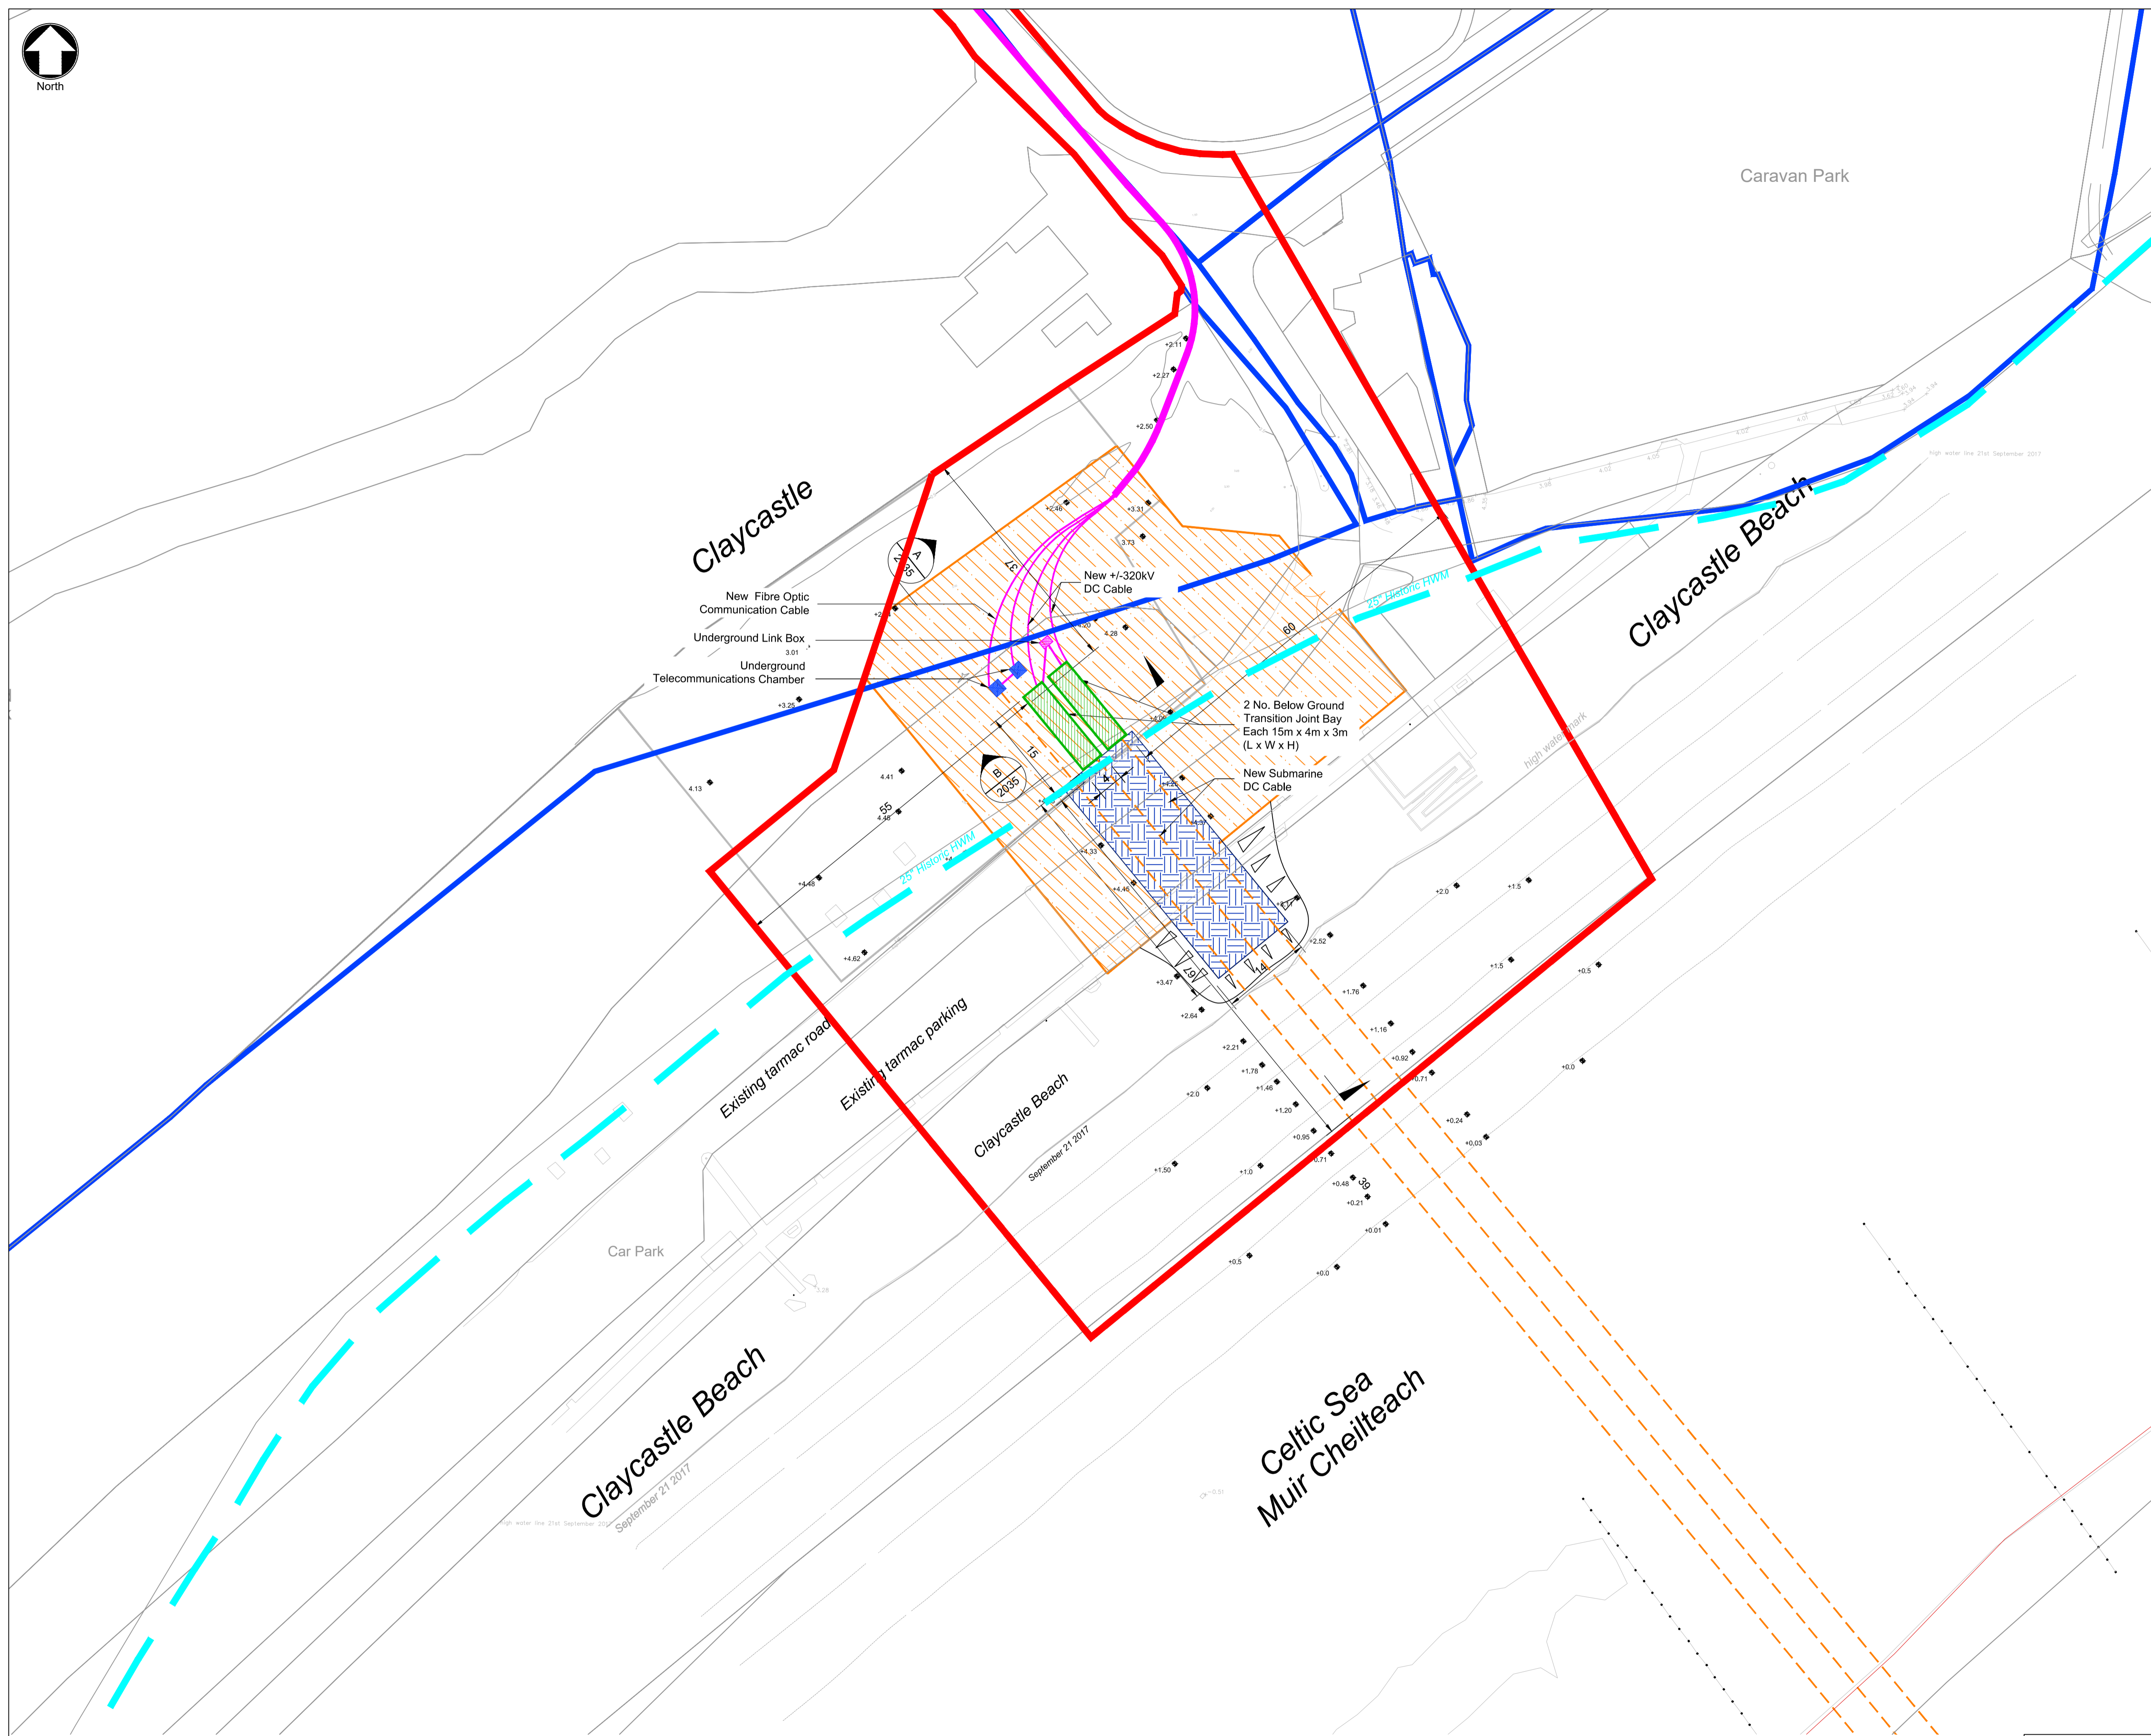

**Notes**

1. For planning purposes only. Not for construction.
2. All dimensions are in metres unless otherwise noted.
3. Where levels are shown, all levels are in metres above Malin Head datum

---

**Key to symbols**

- Application Site Boundary
- Landowner Property Boundary
- HVDC Underground Cable Route
- Offshore HVDC Cable
- 25" Historic High Water Mark
- OSI 2020 High Water Mark
- Temporary Construction Compound & Laydown Area
- Underground Transition Joint Bay
- Temporary Cofferdam for Construction Works

---

**Scale**  
1:500

0 10m 25m 50m

**Reference drawings**

229100428-MMD-00-XX-DR-E-1100 Site Location Plan - Key Plan  
 229100428-MMD-00-XX-DR-E-2030 HVDC Subsea Cable Landfall  
 Claycastle Beach - Plan Layout

PL1	25/06/2021	SHY	Issued for Planning	DH	TK
Rev	Date	Drawn	Description	Ch'k'd	App'd

**MOTT MACDONALD**

South Block  
 Rockfield  
 Dundrum  
 Dublin 16  
 Ireland  
 T +353 (0)1 291 6700  
 F  
 W www.mottmac.com

Client

**Title**

Celtic Interconnector  
 HVDC Subsea Cable Landfall  
 Claycastle Beach  
 Site Layout  
 Option 2

Designed	I. Eustace	Eng check	D. Hassett
Drawn	S. Healy	Coordination	D. Monaghan
Dwg check	D. Monaghan	Approved	T. Keane

Scale at A1	Status	Rev	Security
1:500	APR	PL1	STD

Drawing Number  
 229100428-MMD-00-XX-DR-E-2031

© Mott MacDonald Ireland  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

OS Mapping Reference:  
 OS6348

©Ordnance Survey Ireland/Government of Ireland.  
 Ordnance Survey Ireland Licence No. EN0061519-24